


# BA567E-SS Rugged one input General purpose Counter

Issue 7

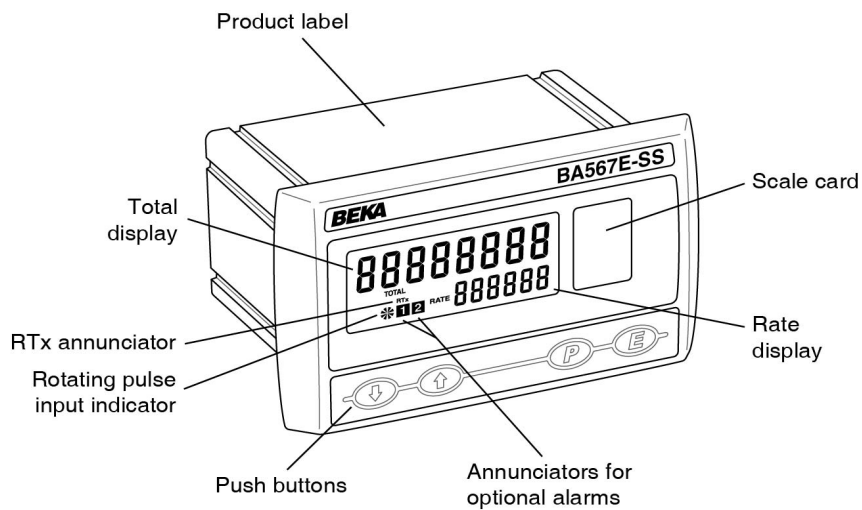

## CONTENTS

### 1. Description

### 2. Operation

- 2.1 Initialisation
- 2.2 Controls
- 2.3 Displays

### 3. System Design

- 3.1 Power supply
- 3.2 Pulse input
  - 3.2.1 Switch contact input
  - 3.2.2 2-wire proximity detector input
  - 3.2.3 Open collector input
  - 3.2.4 Magnetic pick-off input
  - 3.2.5 Voltage pulse input
- 3.3 Remote reset

### 4. Installation

- 4.1 Location
- 4.2 Installation procedure
- 4.3 EMC
- 4.4 Counter earthing
- 4.5 Scale card

### 5. Configuration and Calibration

- 5.1 Configuration structure
- 5.2 Accessing the configuration functions
- 5.3 Summary of configuration functions
- 5.4 Input:  $\text{Input}$
- 5.5 Input type:  $\text{InputType}$
- 5.6 Input debounce:  $\text{debounce}$
- 5.7 Input pulse counting edge:  $\text{edge}$
- 5.8 Display update interval:  $\text{update}$
- 5.9 Upper display:  $\text{d1 SP-1}$
- 5.10 Lower display:  $\text{d1 SP-2}$
- 5.11 Position of the decimal points:  $\text{dP}$
- 5.12 Total scale factor:  $\text{SCALE.t}$
- 5.13 Rate scale factor:  $\text{SCALE.r}$
- 5.14 Timebase:  $\text{t-base}$
- 5.15 Display filter:  $\text{Filter}$
- 5.16 Direction of count:  $\text{up or dn}$
- 5.17 Reset value:  $\text{CLR VAL}$
- 5.18 Local reset:  $\text{Loc CLR}$
- 5.19 Local total reset:  $\text{CLR tot}$
- 5.20 Local grand total reset:  $\text{CLR gtot}$
- 5.21 Reset grand total from configuration menu:  $\text{CLR gtot}$
- 5.22 Security code:  $\text{code}$
- 5.23 Reset configuration to factory defaults:  $\text{reset def}$
- 5.24 Display overflow

### 6. Configuration example

### 7. Maintenance

- 7.1 Fault finding during commissioning
- 7.2 Fault finding after commissioning
- 7.3 Servicing
- 7.4 Routine maintenance
- 7.5 Guarantee
- 7.6 Customer comments

### 8. Accessories

- 8.1 Scale card
- 8.2 Tag information
- 8.3 Alarms
  - 8.3.1 Solid state output
  - 8.3.2 Configuration summary
  - 8.3.3 Alarm enable:  $\text{Enbl}$
  - 8.3.4 Type of alarm:  $\text{type}$
  - 8.3.5 Setpoint adjustment:  $\text{SP lx \& SP2x}$
  - 8.3.6 Alarm function:  $\text{H.Lo}$
  - 8.3.7 Alarm output status:  $\text{on.off}$
  - 8.3.8 Hysteresis:  $\text{H5tr}$
  - 8.3.9 Alarm delay:  $\text{dELR}$
  - 8.3.10 Alarm silence time:  $\text{S.L}$
  - 8.3.11 Flash display when alarm occurs:  $\text{FLASH}$
  - 8.3.12 Access Setpoint:  $\text{RCLSP}$
  - 8.3.13 Adjusting alarm setpoints from display mode.
- 8.4 Pulse Output
  - 8.4.1 System design
  - 8.4.2 Configuration
  - 8.4.3 Access Pulse output sub-menu:  $\text{PUL SE oP}$
  - 8.4.4 Enable pulse output:  $\text{Enbl}$
  - 8.4.5 Source of pulse output:  $\text{Source}$
  - 8.4.6 Divide output pulse frequency:  $\text{div, u, dE}$
  - 8.4.7 Output pulse width:  $\text{dur RE, on}$
- 8.5 4/20mA output
  - 8.5.1 System design
  - 8.5.2 Configuration
  - 8.5.3 Access 4/20mA output sub-menu:  $\text{4-20 oP}$
  - 8.5.4 Enable 4/20mA output:  $\text{Enbl}$
  - 8.5.5 Select rate or total source:  $\text{4-20 type}$
  - 8.5.6 Display corresponding to 4mA output:  $\text{4.000}$
  - 8.5.7 Display corresponding to 20mA output:  $\text{20.000}$
- 8.6 Display backlight

## 1. DESCRIPTION

This rugged general purpose, one input Counter may be configured to count input pulses from a wide variety of sensors and to display the total number in engineering units. A smaller six digit display may be activated to show the input pulse rate in engineering units per second, minute or per hour.

## 2. OPERATION

Fig 1 shows a simplified block diagram of the BA567E-SS Counter. The instrument can be supplied with a factory fitted internally powered display backlight, plus one of the following three factory fitted accessories:

Dual isolated alarms

or Isolated pulse output

or Isolated 4/20mA output

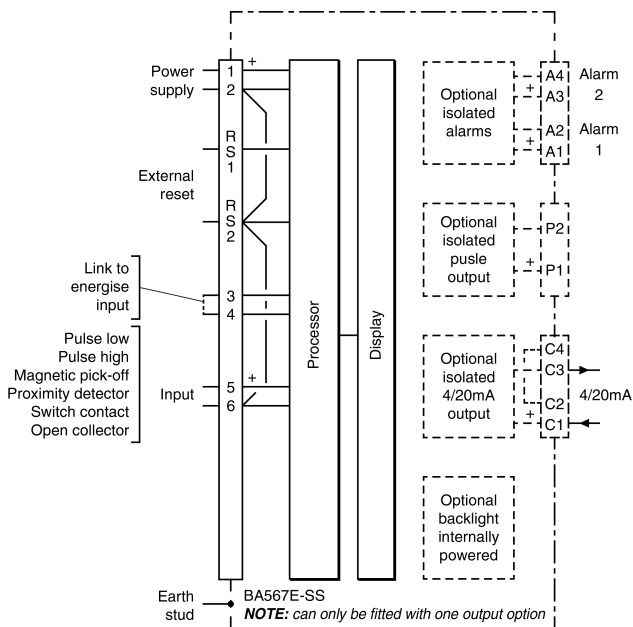


Fig 1 BA567E-SS block diagram

### 2.1 Initialisation

Each time power is applied to a BA567E-SS Counter initialisation is performed. After a short delay the following display sequence occurs:

All segments of the display are activated

Counter starts functioning, using the configuration information stored in the instrument's permanent memory. Unless total and grand total displays have been reset to zero, new pulses will be added to the existing totals.

### 2.2 Controls

The BA567E-SS Counter is controlled and configured via four front panel push buttons. In the display mode i.e. when the instrument is counting, the push button functions are:

#### Push Button Functions

**[P] + [E]** Access to configuration menu

**[▼] + [▲]** If Local Total Reset [Lr tot] in the instrument configuration menu has been activated, operating the [▼] and [▲] buttons simultaneously for three seconds will reset the total display to zero and clear any pulses stored in the optional pulse output. See 5.19

**[E] + [▼]** Grand total - shows Ld followed by least significant 8 digits of the 16 digit grand total.

**[E] + [▲]** Grand total - shows Hr followed by the most significant 8 digits of the 16 digit grand total.

If Local Grand Total Reset [Lr gtd] in the instrument configuration menu has been activated, operating the [E] and [▲] buttons simultaneously for ten seconds will result in [Lr.no] being displayed with the no flashing. Operating the [▲] or [▼] button will change the display to [Lr.4E5], the [E] button will then reset the grand total to zero which will be confirmed by a brief display of [Lr.d]. See 5.20

**[P] + [▼]** Shows firmware version

**Note:** When optional alarms are fitted, the BA567E-SS Counter may be configured to provide direct access to the alarm setpoints from the display mode when the [P] and [▲] buttons are operated simultaneously. See 8.3.13

### 2.3 Displays

The BA567E-SS Counter has two digital displays and associated annunciators, plus a pulse input indicator as shown on the front page of this manual.

**Total display** Shows the total pulse count on the upper eight digit display. May be reset to zero via front panel push buttons or by a remote reset switch.

**Rate Display** Shows the pulse rate on the lower six digit display. Total and rate displays may be reversed.

**Pulse input indicator** This disc in the lower left hand corner of the display 'rotates' for two seconds each time an input pulse is received on either input. Appears to rotate continuously when combined input frequency on both inputs exceeds 0.5Hz.

**Reset annunciator** Activated while the total display is being reset via the front panel push buttons, or the external reset terminals.

**Rate annunciator** Identifies rate display

**Total annunciator** Identifies total display

**RTx annunciator** Retransmitted pulse annunciator.  
Depends upon the setting of `SCALE` in the pulse output configuration menu.

#### **SCALE**

Annunciator activated each time pulse output open collector is *on*, i.e.  $R_{on}$  is less than  $60\Omega + 3V$ .

#### **drift**

Annunciator continuously activated.

### 3. SYSTEM DESIGN

Fig 2 illustrates the basic circuit that is used for all BA567E-SS Counter installations. For simplicity, connections for the optional alarms, pulse output and 4/20mA output are shown separately in section 8 this manual.

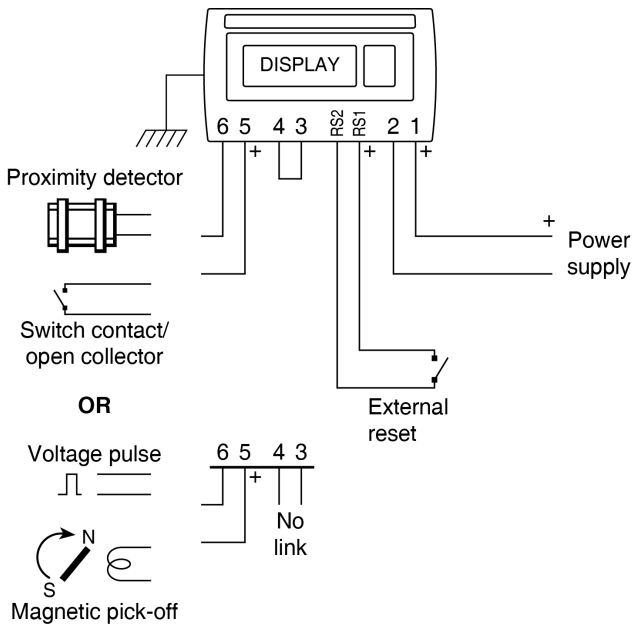


Fig 2 BA567E-SS connections

When designing a system it is important to remember that terminals 2, 6 and RS2 are interconnected within the BA567E-SS see Fig 1.

#### 3.1 Power supply

The BA567E-SS Counter requires a 10 to 30V dc supply between terminal 1 & 2 and consumes:

	10mA	without optional backlight
plus	6mA	when terminals 3 & 4 are linked
plus	22mA	for optional backlight

#### 3.2 Pulse input

As shown in Fig 2 the BA567E-SS can count pulses from a wide variety of sensors.

The following table shows the switching thresholds for the various types of sensor. For reliable counting the pulse input must fall below the lower threshold and rise above the upper threshold.

Input sensor	Switching thresholds	
	Lower	Upper
Switch	100Ω	1000Ω
Proximity detector	1.2mA	2.1mA
Open collector	2kΩ	10kΩ
Magnetic pick-off	0mV	40mV peak
Voltage pulse low	1.0V	3.0V
Voltage pulse high	3.0V	10.0V

#### 3.2.1 Switch contact input

Any switch contact may be directly connected to pulse input terminals 5 and 6. The BA567E-SS contains a configurable debounce circuit to prevent contact bounce being counted. See section 5.6 including details of the maximum counting frequency.

#### 3.2.2 2-wire proximity detector input

Most NAMUR 2-wire proximity detector may be directly connected to the BA567E-SS pulse input, providing the minimum operating voltage of the proximity detector is less than 7.5V. The BA567E-SS contains a configurable debounce circuit to prevent false triggering. Three levels of debounce protection are independently available. See section 5.6.

#### 3.2.3 Open collector input

Sensors with an open collector output may be directly connected to Counter input terminals 5 & 6. Polarity of the sensor output should be observed. The BA567E-SS contains a configurable debounce circuit to prevent false triggering. Three levels of debounce protection are independently available. See section 5.6.

#### 3.2.4 Magnetic pick-off input

Sensors incorporating a magnetic pick-off will have a low level voltage output unless the sensor incorporates an amplifier. The BA567E-SS input configuration menu is a low level voltage pulse input intended for use with a magnetic pick-off. The Counter contains a configurable debounce circuit to prevent false triggering of the instrument. See section 5.6.

#### 3.2.5 Voltage pulse input

Two voltage pulse input ranges are selectable in the BA567E-SS Counter configuration menu, **0.1V to 1V** and **1V to 10V** shown in section 3.2. The Counter contains a configurable debounce circuit to prevent false triggering of the instrument. Three levels of debounce protection are independently available. See section 5.6.

#### 3.3 Remote reset

The Counter's total display may be remotely reset to zero by connecting terminals RS1 and RS2 together for more than one second. Permanent interconnection inhibits counting.

**Note:** The BA567E may also be configured to reset the total display to zero by operating the and push buttons simultaneously for more than two seconds in the totalising mode i.e. when the instrument is displaying flow. See 5.19

## 4. INSTALLATION


### 4.1 Location

The BA567E-SS has a stainless steel case with a 10mm thick toughened glass window. The case provides 7J and the window 4J front of panel impact protection. The captive silicone gasket, which seals the joint between the instrument and the panel enclosure, ensures IP66 front of panel ingress protection. The rear of the Counter has IP20 protection.

Fig 3 shows the overall dimensions of the BA567E-SS together with the recommended panel enclosure cut-out dimensions and terminal locations.

### 4.2 Installation Procedure

- Cut the aperture specified in Fig 3 in the panel enclosure. Ensure that the edges of aperture are de-burred.
- Inspect the Counter's captive gasket and ensure that it is not damaged before inserting the Counter into the panel enclosure aperture.
- If the enclosure panel is less than 1.0mm thick, or is non-metallic, an optional BEKA stainless steel support plate should be slid over the rear of the Counter before the panel clamps are fitted to evenly distribute the clamping force and prevent the enclosure panel being distorted or creeping.
- Slide a panel clamp into the two grooves at each corner of the indicator housing with the M3 stud protruding through the hole at the rear of the clamp. Fit the stainless steel spring washer over the stud and secure with the stainless steel wing nut.
- Evenly tighten the four clamps to secure the instrument. The recommended minimum tightening torque for each wing nut is 22cNm (1.95 lbf in).
- Connect the panel enclosure wiring to the rear terminal blocks. To simplify installation, the terminals are removable so that wiring can be completed before the instrument is installed. Cables should be mechanically secured to ensure terminals are not damaged by vibration.
- Finally fit a silicone rubber push-on cap to the end of each M3 threaded rod.

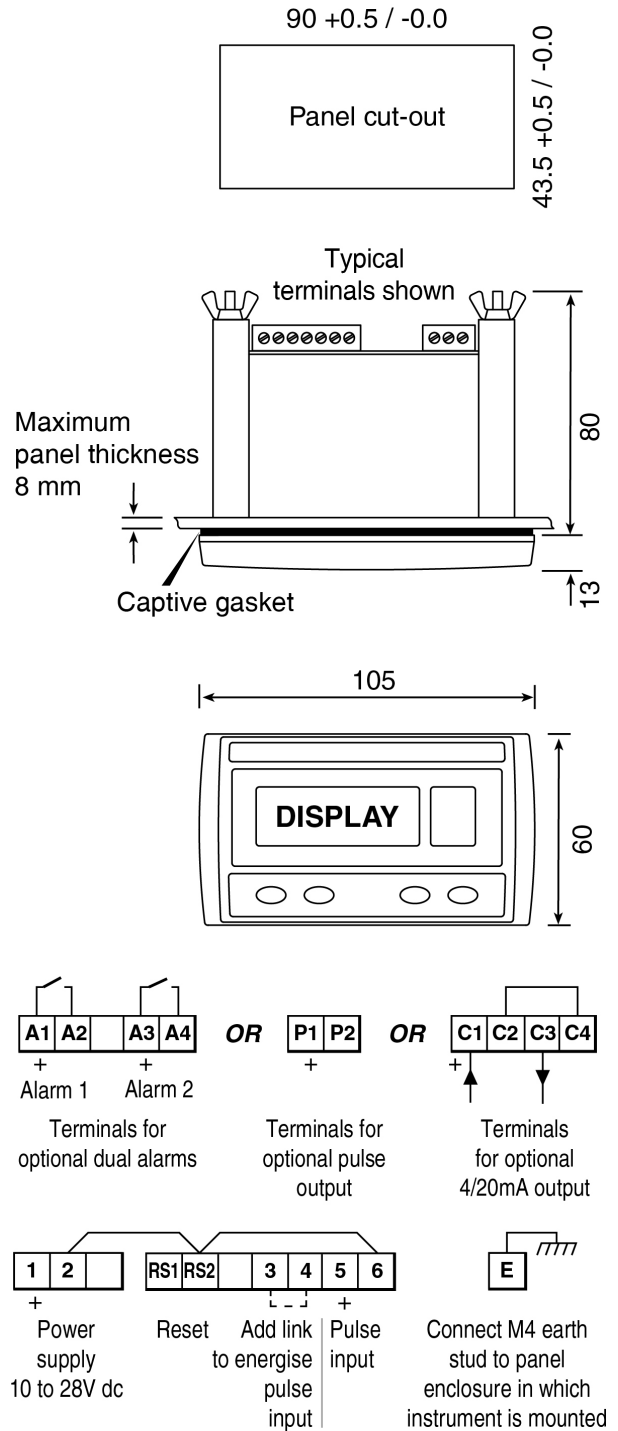

Support panel wiring to prevent vibration damage

**Note:** Optional backlight is internally powered

Fig 3 Dimensions and terminals

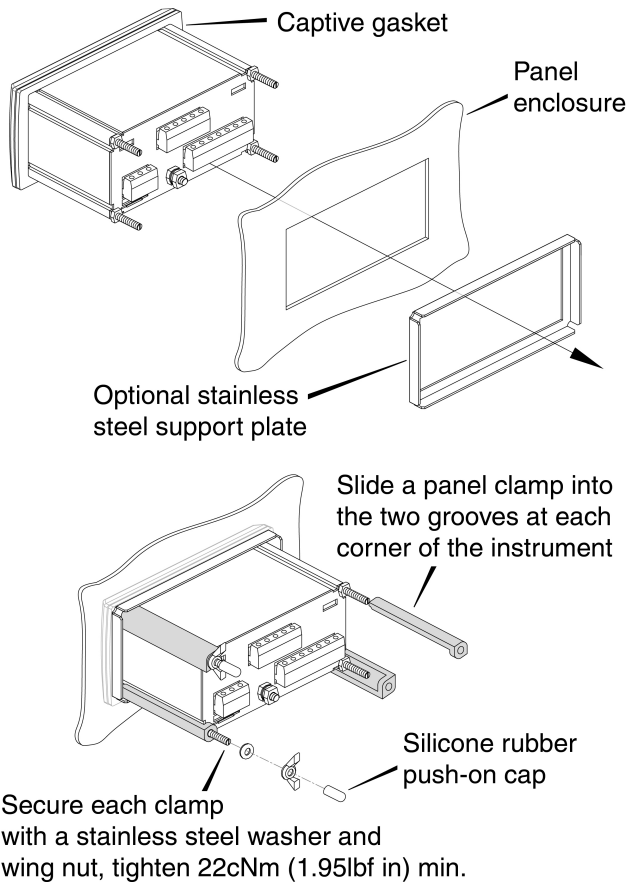


Fig 4 Installation procedure

#### 4.3 EMC

The BA567E-SS complies with the requirements of the European EMC Directive 2014/30/EU and UK Electromagnetic Compatibility Regulations UKSI 2016:1091 (as amended). For specified immunity all wiring should be in screened twisted pairs, with the screens earthed at one point.

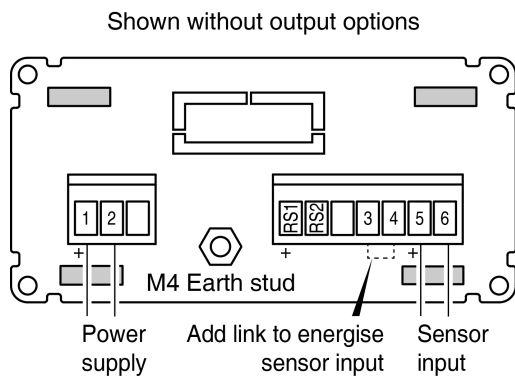


Fig 5 Terminals for field wiring

#### 4.4 Counter earthing

The BA567E-SS has an M4 earth stud on the rear panel which should be electrically connected to the panel enclosure in which the instrument is mounted, or to the plant equipotential conductor.

#### 4.5 Scale card

The Counter's units of measurement are shown on a printed scale card in a window at the right hand side of the display. The scale card is mounted on a flexible strip that is inserted into a slot at the rear of the instrument as shown in Fig 6. Thus the scale card can easily be changed without removing the Counter from the panel or opening the instrument enclosure.

New Counters are supplied with a printed scale card showing the requested units of measurement, if this information is not supplied when the instrument is ordered a blank card will be fitted.

A pack of self-adhesive scale cards printed with common units of flow measurement is available as an accessory from BEKA associates. Custom printed scale cards can also be supplied.

To change a scale card, unclip the tapered end of the flexible strip at the rear of the instrument by gently pushing it upwards and pulling it out of the enclosure. Peel the existing scale card from the flexible strip and replace it with a new printed card, which should be aligned as shown below. Do not fit a new scale card on top of an existing card.

Install the new scale card by gently pushing the flexible strip into the slot at the rear of the Counter, when it reaches the internal end-stop secure it by pushing the end of the flexible strip downwards so that the tapered section is held by the rear panel.

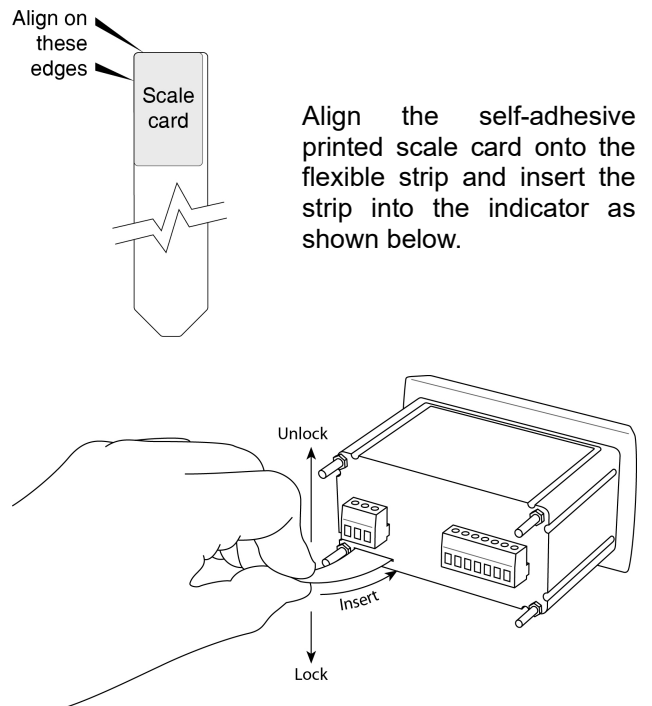


Fig 6 Inserting flexible strip carrying scale card into slot at the rear of the Tachometer.

## 5.0 CONFIGURATION & CALIBRATION

The BA567E-SS Counter is configured and calibrated via four front panel push buttons. All the configuration functions are contained in an easy to use intuitive menu that is shown diagrammatically in Fig 8.

Each menu function is summarised in section 5.3 of this manual and each summary includes a reference to more detailed information.

When factory fitted optional dual alarms, pulse output or a 4/20mA output are included, additional functions appear in the configuration menu which are described separately in section 8.

All new BA567E-SS Counters are supplied calibrated as requested at the time of ordering. If calibration is not requested, Counters will have default configuration as shown in the following table, but can easily be re-configured on-site.

Function	Display	Default
Input		
Input type	INP.TYPE	OP.COL
Debounce	DEBOUNCE	DEFAULT
Counting edge	CNT EDGE	EDGE 1
Update	UPD.RTE	05
Upper display	di SP-1	total
Lower display	di SP-2	on
Decimal point	dP	Rate 00000.0 Total 00000000
Total scale factor	SCALE.t	00 1.00
Rate scale factor	SCALE.r	00 1.00
Timebase	t-base	tb-0 1
Filter	F.LtEr	24
Counter direction	uP or dN	uP
Clear value	CLR VAL	00000000
Local clear		
Local total reset	CLR tot	OFF
Local grand total reset	CLR Gtot	OFF
Security code	code	0000

**Note:** While the instrument is being configured counting continues so that any input pulses occurring during this time are recorded.

### 5.1 Configuration structure

Fig 7 shows the configuration structure of the BA567E-SS Counter. The pulse input is passed to the SCALE.r and SCALE.t functions allowing the independent rate and total displays to have different engineering units.

SCALE.t is a dividing factor that converts the input pulses into the required total display in engineering units. e.g. if the input is two pulses per pump stroke and it is required to display the total number of pump strokes in thousands of strokes, SCALE.t should be set to 2000.

SCALE.r is a dividing factor that converts the input pulses into a rate display with the required engineering units. e.g. if the input is two pulses per pump stroke and it is required to display the pump stroke rate, SCALE.r should be set to 2.0.

The timebase t-base is a multiplying factor that determines if the instrument displays pulse rate per second, per minute or per hour.

The BA567E-SS uses 'real' decimal points. Moving the position of a decimal point in a scale factor will affect the instrument calibration.















Fig 7 Calibration structure

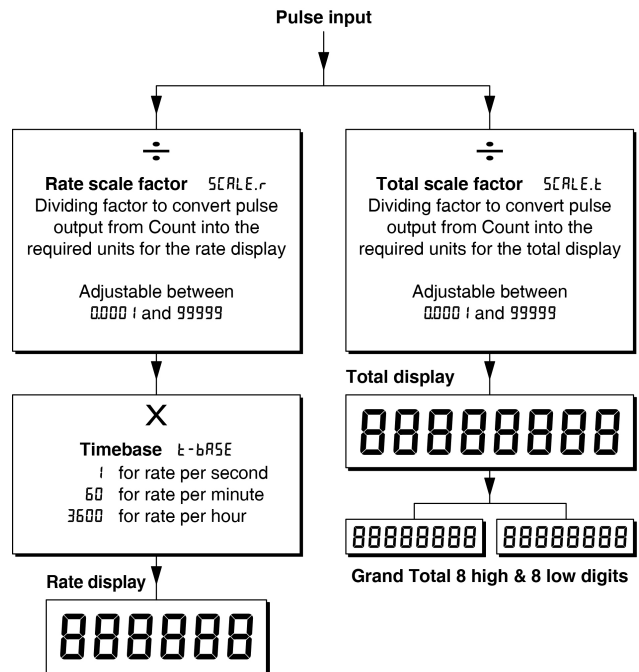



## 5.2 Accessing configuration functions

Throughout this manual the instrument front panel push buttons are shown as , ,  and  and legends displayed by the instrument are shown in a seven segment font as displayed by the Counter e.g. *F1 LkEr* and *5CRLE.r*.

Access to the configuration menu is obtained by operating the  and  push buttons simultaneously. If the instrument is not protected by a security code the first parameter *i nPul* will be displayed. If a security code other than the default code *0000* has already been entered, the instrument will display *LoDE*. Press  to clear this prompt and enter the security code for the instrument using the  or  push button to adjust the flashing digit, and the  push button to transfer control to the next digit. If the correct code has been entered pressing  will cause the first parameter *i nPul* to be displayed. If an incorrect code is entered, or a push button is not operated within ten seconds, the instrument will automatically return to the display mode.

All configuration functions and prompts are shown on the upper eight digit display.

Once within the configuration menu the required function can be selected by scrolling through the menu using the  and  push buttons. The configuration menu is shown diagrammatically in Fig 8.

When returning to the display mode following reconfiguration, the BA567E-SS Counter will display *dRtR* followed by *5RUE* while the new information is stored in permanent memory.

If after accessing the configuration menu the interval between operating any front panel push button exceeds one minute, the BA567E-SS will automatically return to the display mode and any configuration changes will not be stored in permanent memory. When making changes to multiple configuration functions, it is therefore sensible to occasionally return to the display mode to save the changes that have already been made.

## 5.3 Summary of configuration functions

This section summarises all the configuration functions. When read in conjunction with Fig 8 it provides a quick aid for configuring the Counter. If more detail is required, each section contains a reference to a full description of the function.

Display	Summary of function
<i>i nPul</i>	Contains sub-menu with two functions: <i>i nP.tYPE</i> Select Input type <i>dEbounCE</i> Set debounce <b>See section 5.4</b>
	<b><i>i nP.tYPE</i></b> Configures input to accept one of six types of input: <i>oP.LoL</i> Open collector * <i>VoLLeS L</i> Voltage pulse <1 >3V <i>VoLLeS H</i> Voltage pulse <3 >10V <i>LoL</i> Magnetic pick-off <i>P.r.dEt</i> Proximity detector * <i>LoNtREt</i> Switch contact *
	* Link terminals 3 & 4 <b>See section 5.5</b>
	<b><i>dEbounCE</i></b> Defines level of input debounce applied to the pulse input to prevent false counting: <i>dEFRAuLt</i> <i>HEAUU</i> <i>L, GHt</i> <b>See section 5.6</b>
<i>Ent EdGE</i>	<b>Input pulse counting edge</b> Defines whether the Counter is incremented/decremented on the leading or trailing edge of an input pulse. <b>See section 5.7</b>
<i>uPdRtE</i>	<b>Display update interval</b> Defines the interval between display updates between 0.5 and 5 seconds. <b>See section 5.8</b>

Display	Summary of function
<b>d, 5P-1</b>	<b>Upper display</b> Defines whether <i>rATE</i> or <i>tOTAL</i> are shown on the upper display. The other variable will be shown on the lower display, providing the lower display is on in function <i>d, 5P-2</i> . <b>See section 5.9</b>
<b>d, 5P-2</b>	<b>Lower display</b> Turns the lower display, which normally shows rate, on or off. <b>See section 5.10</b>
<b>dP</b>	<b>Position of decimal points</b> Defines the position of the decimal point in both the total and rate displays. <b>See section 5.11</b>
<b>SCALE.t</b>	<b>Total Scale Factor</b> SCALE.t is a dividing factor that converts the number of input pulses into the required total display in engineering units. SCALE.t may be adjusted between 0.0001 & 99999. e.g. if one input pulse represents 1 centimetre of dispensed cable and the total display is required in metres, SCALE.t should be set to 100.0 which is the number of centimetres in a metre. The total display is independent of the rate display. <b>See section 5.12</b>
<b>SCALE.r</b>	<b>Rate scale factor</b> SCALE.r is a dividing factor that converts the input pulse rate into the required rate display in engineering units. SCALE.r may be adjusted between 0.0001 and 99999. e.g. if one pulse represents 2 pump strokes and the rate display is required in pump strokes, SCALE.r should be set to 2.0. The rate display is independent of the total display. <b>See section 5.13</b>

Display	Summary of function
<b>t-bASE</b>	<b>Timebase</b> Selectable multiplier allowing rate to be displayed in units per second, per minute or per hour. Select: t-b-01 for rate / second t-b-60 for rate / minute t-b-3600 for rate / hour <b>See section 5.14</b>
<b>F, LEEr</b>	<b>Display filter</b> Is an adjustable digital filter to reduce the noise on the rate display. The filter has two parameters each represented by a digit adjustable between 0 and 9. The first digit defines the amount of filtering applied to the display, the second digit the deviation from the displayed rate at which the filter will be overridden and the rate display will move rapidly to the new value. <b>See section 5.15</b>
<b>uP or dN</b>	<b>Direction of count</b> Determines whether input pulses increment or decrement the total display. <b>See section 5.16</b>
<b>CLR UAL</b>	<b>Reset value</b> Defines a preset number to which the total display will be set when the BA567E-SS Counter is locally or remotely reset. Enables the instrument to count down from a preset number. <b>See section 5.17</b>



Display	Summary of function
---------	---------------------

**LoL CLr****Local clear**

Contains sub-menu with two functions enabling the total and the grand total to be reset via the front panel push buttons while the Counter is in the display mode.



**See section 5.18**

**CLr tot**

When **tot** is selected total display is reset when  and  buttons are operated simultaneously for more than three seconds in the display mode.

**See section 5.19**

**CLr Gtot**

When **tot** is selected the grand total may be reset when  and  buttons are operated simultaneously for more than 10 seconds in the display mode - see section 2.2 for details.

**Note:** Once reset, the grand total can not be restored.

**See section 5.20**

**CLr Gtot****Resets grand total to zero from within configuration menu.**

This function resets the grand total to zero from within the configuration menu when **CLr GEF** is selected.

**Note:** Once reset, the grand total can not be recovered.

**See section 5.21**

Display	Summary of function
---------	---------------------

**Code****Access code**

Defines a four digit alphanumeric code that must be entered to gain access to the configuration menu. Default code **0000** disables the security function and allows unrestricted access to all configuration functions.


**See section 5.22**

**rSEt dEF****Reset to factory defaults**

Returns the BA567E-SS Counter to the factory defaults shown in section 6.0 To prevent accidental use the request must be confirmed by entering **SurE** before the reset will be executed.

**See section 5.23**



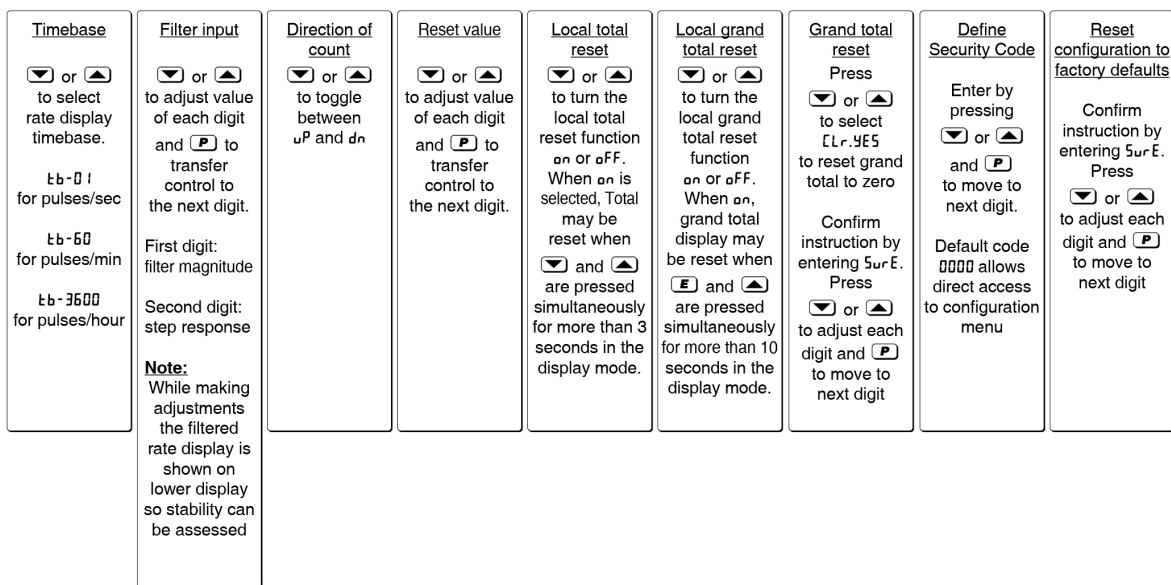

#### 5.4 Input: , nPUL

The Input function contains two sub-functions , nP.ETYPE and dEBOUNC which define the type of input and the amount of input noise rejection.

#### 5.5 Input type: , nP.ETYPE

, nP.ETYPE is a sub-menu in the , nPUL function which defines the type of input sensor or input pulse that the instrument will count. To check or change the type of input, select , nPUL in the configuration menu and press **[P]** which will reveal the , nP.ETYPE prompt, pressing **[P]** again will show the existing Input setting. If set as required press **[E]** twice to return to the configuration menu, or repeatedly press the **[V]** or **[A]** button until the required type of input is displayed and then press **[E]** twice to return to the configuration menu.

One of following six types of input may be selected:

		Switching thresholds	
		Low	High
oP.LOL	Open collector <sup>2</sup>	2	10kΩ
UOLLSL	Voltage pulse low <sup>1</sup>	1	3V
UOLLSH	Voltage pulse high <sup>1</sup>	3	10V
LOL	Magnetic pick-off	0	40mV
Pr.dEL	Proximity detector <sup>2</sup>	1.2	2.1mA
LOnRLE	Switch contact <sup>2</sup>	100	1000Ω

#### Notes:

1. Maximum voltage input +30V.
2. For sensors connected to the input that require energising i.e. proximity detectors, switch contacts or open collector sensors, terminals 3 & 4 of the BA567E-SS should be linked together.
3. To count correctly, the input pulse must fall below the lower switching threshold and rise above the higher switching threshold.
4. See section 5.6 for maximum counting frequency.

#### 5.6 Input debounce: dEBOUNC

dEBOUNC is an adjustable sub-menu in the , nPUL function which prevents the input miscounting when the input pulse has noisy edges, such as those resulting from a mechanical contact closing and bouncing.

Three levels of protection may be selected. The amount of debounce applied depends upon the type of Counter input that has been selected in the , nP.ETYPE function.

Select , nPUL in the configuration menu and press **[P]** which will reveal the , nP.ETYPE prompt, press the **[V]** or **[A]** button to select dEBOUNC followed by **[P]** to reveal the existing setting. Pressing the **[V]** or **[A]** button will scroll through the three levels. When the required level has been selected, pressing **[E]** twice will enter the selection and return the display to the configuration menu.

The following table shows the minimum time that the input pulse must be continuously above the upper input switching threshold and continuously below the lower switching threshold to ensure that the Counter processes the input pulse. Input switching thresholds are shown in section 5.5.

debounce level	Min input pulse width	
	Type of Input	
	Contact	All others
Default	1600µs	40µs
Heavy	3200µs	350µs
Light	400µs	5µs

The maximum counting frequency of the BA567E-SS depends upon the debounce level selected, the shape of the input pulse and its amplitude. The following table assumes a square wave input and is included for guidance. The maximum counting frequency will be lower if the input pulses have sloping edges and the pulse amplitude only slightly exceeds the input switching thresholds.

ONLY FOR GUIDANCE		
debounce level	Max counting frequency	
	Type of input	
	Contact	All others
Default	250Hz	12kHz
Heavy	120Hz	2kHz
Light	1000Hz	100kHz

The minimum counting frequency is 0.01Hz. Below this frequency the rate display is forced to zero.

### 5.7 Input pulse counting edge: $\overline{CnE}$ EdGE

This function defines whether the BA567E-SS Counter is incremented/decremented on the leading or trailing edge of an input pulse.

To check or change the input pulse edge on which the count occurs select  $\overline{CnE}$  EdGE from the configuration menu and press  $\overline{P}$  which will reveal EdGE 1 or EdGE 2. If required press the  $\nabla$  or  $\blacktriangle$  button to change the setting, followed by the  $\overline{E}$  button to return to the configuration menu.

#### EdGE 1

Type of input	Counting edge
Voltage	Low to high
Switch contact	Closed to open
Open collector	Closed to open
Proximity detector	High to low current

#### EdGE 2

Type of input	Counting edge
Voltage	High to low
Switch contact	Open to closed
Open collector	Open to closed
Proximity detector	Low to high current

### 5.8 Display update interval: $\mu P d R L E$

If either the rate or the total display is likely to change rapidly, a longer interval between display updates may simplify reading. This function allows one of six different display intervals between 0.5 and 5 seconds to be selected. The selected display update interval does not affect the update time of any other instrument function.

To adjust the update interval select  $\mu P d R L E$  from the configuration menu and press  $\overline{P}$  to reveal the current update interval. Pressing the  $\nabla$  or  $\blacktriangle$  button will scroll through the six times. When the required interval has been selected press  $\overline{E}$  to enter the selection and return to the configuration menu.

### 5.9 Upper display: $d, 5P-1$

Usually the total count is shown on the larger upper eight digit display, but this function reverses the display locations allowing rate to be shown on the larger upper display and total on the smaller lower display.

To check the setting for the display, select  $d, 5P-1$  from the configuration menu and press  $\overline{P}$  which will reveal if the display is showing  $r R L E$  or  $t o t R L$ . The setting can be changed by pressing the  $\nabla$  or  $\blacktriangle$  button followed by the  $\overline{E}$  button to enter the selection and return to the configuration menu.

### 5.10 Lower display: $d, 5P-2$

This function turns the lower display on or off. When turned off, the BA367E-SS will only have one eight digit display which may be configured in the  $d, 5P-1$  function to show the total count or rate.

To check the setting for the lower display, select  $d, 5P-2$  from the configuration menu and press  $\overline{P}$  that will reveal if the lower display is on or off. The setting may be changed by pressing the  $\nabla$  or  $\blacktriangle$  button followed by the  $\overline{E}$  button to enter the selection and return to the configuration menu.

### 5.11 Position of the decimal points: $dP$

The upper and lower displays have eight and six digits respectively. This function enables the position of the decimal point in both displays to be independently positioned as shown below.

#### Upper display

Total	0000.0000	1 of 5 positions or absent
Rate	00.0000	1 of 4 positions or absent

#### Lower display

Total	0.0000	1 of 5 positions or absent
Rate	0.0000	1 of 4 positions or absent

To adjust the position of the decimal points select  $dP$  from the configuration menu and press  $\overline{P}$ . The upper display defined as the rate or total display by function  $d, 5P-1$  (section 5.9) will be activated and identified by the display annunciator as Rate or Total. The decimal point, which may be positioned as shown in the table above, is moved by operating the  $\nabla$  or  $\blacktriangle$  push button. The  $\nabla$  button moves the position of the decimal point to the left and the  $\blacktriangle$  button moves the decimal point position to the right.

When the decimal point in the upper display has been positioned pressing the  $\overline{P}$  button will transfer control to the lower display variable, but it will be shown and annunciated on the larger upper display. The position of the decimal point may be positioned in the same way by operating the  $\nabla$  and  $\blacktriangle$  push buttons. When both decimal points are positioned as required, enter the settings and return to the configuration menu by operating the  $\overline{E}$  button.

#### Note:

Adjustment of a decimal point position will disable the following outputs which must be re-enabled after the adjustment is complete:

Optional Pulse output

Optional Alarm outputs

Optional 4/20mA output

### 5.12 Total scale factor: $SCALE.t$

$SCALE.t$  is a dividing factor adjustable between 0.0001 and 99999 that enables the total to be displayed in engineering units. e.g. if one input pulse represents 1 centimetre of dispensed cable and the total display is required in metres,  $SCALE.t$  should be set to 100.0 which is the number of centimetres in a metre. If a display of the total number of input pulses is required,  $SCALE.t$  should be set to 1.0. The total display is independent of the rate display.

To check or change the total scale factor select  $SCALE.t$  from the configuration menu and press  $\text{P}$  which will reveal the existing value with one digit flashing. The value of the flashing digit may be changed by pressing the  $\blacktriangledown$  or  $\blacktriangle$  button. When this digit has been adjusted as required, pressing  $\text{P}$  will transfer control to the next digit. When all the digits have been adjusted pressing  $\text{P}$  will transfer control to the decimal point that may be positioned between any of the digits, or may be omitted by moving it to the right of the least significant digit. When the total scale factor has been entered, press  $\text{P}$  to return to the  $SCALE.t$  prompt in the configuration menu.

#### Note:

Adjustment of  $SCALE.t$  will disable the following outputs which must be re-enabled after the adjustment is complete:

Optional Pulse output

Optional Alarm outputs

Optional 4/20mA output

### 5.13 Rate scale factor: $SCALE.r$

$SCALE.r$  is a dividing factor adjustable between 0.0001 and 99999 that enables the rate display to be in engineering units. e.g. if one input pulse represents 2 pump strokes and the rate display is required in pump strokes,  $SCALE.r$  should be set to 2.0. If just the rate of input pulses is required,  $SCALE.r$  should be set to 1.0. The rate display is independent of the total display.

The units of the rate display are counts per unit of time. The unit of time is the timebase of the instrument which is determined by  $t-bASE$  described in section 5.14.

To check or change the rate scale factor select  $SCALE.r$  from the configuration menu and press  $\text{P}$  which will reveal the existing value with one digit flashing. The value of the flashing digit may be adjusted by pressing the  $\blacktriangledown$  or  $\blacktriangle$  button.

When this digit has been adjusted as required, pressing  $\text{P}$  will transfer control to the next digit. When all the digits have been adjusted pressing  $\text{P}$  will transfer control to the decimal point that may be positioned between any of the digits, or may be omitted by moving it to the right of the least significant digit. When the required rate scale factor has been entered, press  $\text{E}$  to return to the  $SCALE.r$  prompt in the configuration menu.

#### Note:

Adjustment of  $SCALE.r$  will disable the following outputs which must be re-enabled after the adjustment is complete:

Optional Pulse output

Optional Alarm outputs

Optional 4/20mA output

### 5.14 Timebase: $t-bASE$

The timebase multiplies the rate display by 1, 60 or 3,600 depending upon whether the BA567E-SS Counter is required to display rate per second, per minute or per hour. See Fig 7.

To check or change the timebase, select  $t-bASE$  from the configuration menu and press  $\text{P}$  which will reveal the current setting. Pressing the  $\blacktriangledown$  or  $\blacktriangle$  button will scroll through the three options:

$t-b-1$  for pulses / second  
 $t-b-60$  for pulses / minute  
 $t-b-3600$  for pulses / hour

When the required multiplier is displayed press  $\text{E}$  to return to the  $t-bASE$  prompt in the configuration menu.

### 5.15 Display filter: $F, LLEr$

The digital display filter has two independent adjustable parameters enabling the rate display response to be tailored for optimum performance. The filter parameters are controlled by a two digit number. The first digit defines the amount of filtering applied to the display as shown below.

First digit	Filter time constant Seconds
0X	0
1X	1.3
2X	4.3
3X	6.5
4X	8.7
5X	11.3
6X	15.7
7X	20.9
8X	25.2
9X	31.5



The second digit defines the deviation from the displayed rate at which the filter will be overridden and the rate display will move rapidly to the new value.

Second digit	Magnitude of step change which will produce a rapid response
X0	Off
X1	1%
X2	2%
X3	4%
X4	8%
X5	12%
X6	16%
X7	24%
X8	32%
X9	64%

By careful adjustment of the two parameters a stable display with an acceptable input step response can be obtained for most applications.

During commissioning it is recommended that initially the second digit is set to 0 (off) and the first digit is adjusted to provide acceptable rate display stability. The second digit should then be increased until the selected step size is greater than the noise on the display signal, at which setting the rate display will become stable. These will be the optimum filter parameters for acceptable rate display stability and a fast response to a large rate signal change.

To check or change the filter select **FILTER** in the configuration menu and press **P** which will reveal the current settings with the first digit flashing. Pressing the **▼** or **▲** button will adjust the flashing digit and **P** will transfer control to the second digit. While making adjustments the filtered rate display is shown on the lower display so that stability can be assessed while adjustments are being made. When set as required, press the **E** button to enter the revised parameters and return to the **FILTER** prompt in the configuration menu.

#### 5.16 Direction of count: **UP or DN**

This function defines whether input pulses increment or decrement the total display. i.e. whether the BA567E-SS is an up-counter or a down-counter.

When configured as a down-counter with a non-zero number entered for the reset value **CLR URL**, the BA567E-SS will count down from the reset value to zero.

To check or change the count direction select **UP or DN** from the configuration menu and press **P** which will reveal the present setting. **UP** indicates that the instrument is an up-counter and **DN** that it is a down counter. Pressing the **▼** or **▲** buttons will toggle the instrument between the two settings. When set as required, press the **E** button to enter the setting and return to the configuration menu.

#### 5.17 Reset value: **CLR URL**

This function defines the value to which the total display is reset when the local or remote reset are operated. This allows the BA567E-SS to be used as a preset down-counter.

When the instrument is used as an up-counter, **CLR URL** is normally set to zero.

To check or change the reset value select **CLR URL** from the configuration menu and press **P** which will reveal the current setting with one digit flashing. The flashing digit may be adjusted by pressing the **▼** or **▲** button. When this digit is correct, pressing **P** will transfer control to the next digit.

When all the digits have been adjusted press the **E** button to enter the revised number and return to the configuration menu.

#### 5.18 Local reset: **LoC CLR**

The Local reset function contains two sub-functions **CLR Tot** and **CLR Gtot** which when enabled allow the total display and grand total to be reset via the instrument front panel push buttons while the BA567E-SS Counter is in the display mode.

### 5.19 Local total reset: $\llcorner \llcorner \llcorner$

$\llcorner \llcorner \llcorner$  is a sub-menu in the  $\llcorner \llcorner \llcorner$  function. When activated it allows an operator to reset the total display to the reset value [see section 5.17] while the BA567E-SS Counter is in the display mode by operating the  $\blacktriangledown$  and  $\blacktriangle$  push buttons simultaneously for more than three seconds.

To check or change the setting select  $\llcorner \llcorner \llcorner$  in the configuration menu and press  $\text{P}$  which will reveal the  $\llcorner \llcorner \llcorner$  prompt, operating  $\text{P}$  again will show if the local total reset is  $\text{on}$  or  $\text{off}$ . If set as required operate the  $\text{E}$  button twice to return to the configuration menu, or the  $\blacktriangledown$  or  $\blacktriangle$  button to change the setting followed by the  $\text{E}$  button twice to enter the change and return to the  $\llcorner \llcorner \llcorner$  prompt in the configuration menu.

#### Note:

The total display may also be remotely reset to the reset value by connecting terminals RS1 and RS2 together for more than one second. See sections 3.3 of this manual.

### 6.20 Local grand total reset: $\llcorner \llcorner \llcorner$

The grand total is a separate sixteen digit counter which is incremented or decremented in parallel with the total display, but is not reset when the total display is reset. The grand total may be viewed in the display mode in two eight digit sections as described in section 2.2 of this manual.

$\llcorner \llcorner \llcorner$  is a sub-menu in the  $\llcorner \llcorner \llcorner$  function which when activated allows the operator to reset the grand total display to zero from the display mode by operating the  $\text{E}$  and  $\blacktriangle$  push buttons simultaneously for more than ten seconds.

To check or change setting select  $\llcorner \llcorner \llcorner$  in the configuration menu and press  $\text{P}$  which will reveal  $\llcorner \llcorner \llcorner$ . Using the  $\blacktriangledown$  or  $\blacktriangle$  button select  $\llcorner \llcorner \llcorner$  and press  $\text{P}$  which will show if local grand total reset is  $\text{on}$  or  $\text{off}$ . If set as required operate the  $\text{E}$  button twice to return to the configuration menu, or the  $\blacktriangledown$  or  $\blacktriangle$  button to change the setting followed by the  $\text{E}$  button twice to enter the change and return to the  $\llcorner \llcorner \llcorner$  prompt in the configuration menu.

#### Note:

Once reset, the grand total can not be recovered.

### 5.21 Reset grand total from configuration menu: $\llcorner \llcorner \llcorner$

The grand total is a separate sixteen digit counter which is incremented or decremented in parallel with the total display, but is not reset when the total display is reset. The grand total may be viewed in the display mode in two eight digit sections as described in section 2.2 of this manual.

To zero the grand total from within the configuration menu select  $\llcorner \llcorner \llcorner$  and press  $\text{P}$  which will cause the instrument to display  $\llcorner \llcorner \llcorner$  with  $\text{no}$  flashing. Using the  $\blacktriangledown$  or  $\blacktriangle$  push button change  $\llcorner \llcorner \llcorner$  to  $\llcorner \llcorner \llcorner$  pressing  $\text{P}$  will result in the instrument displaying  $\text{0000}$  with the first digit flashing. This is a request to confirm the reset instruction by entering  $\text{5urE}$ . Using the  $\blacktriangledown$  or  $\blacktriangle$  button set the first flashing digit to 5 and press  $\text{P}$  to transfer control to the second digit which should be set to  $\text{u}$ . When  $\text{5urE}$  has been entered pressing the  $\text{E}$  button will reset the grand total which will be confirmed by a brief display of  $\llcorner \llcorner \llcorner$ , the instrument will automatically return to the  $\llcorner \llcorner \llcorner$  prompt in the configuration menu.

#### Note:

Once reset, the grand total can not be recovered.

### 5.22 Security code: $\llcorner \llcorner \llcorner$

Access to the instrument configuration menu may be protected by a four digit security code which must be entered to gain access. New instruments are configured with the default security code 0000 which allows unrestricted access to all configuration functions.

To enter a new security code select  $\llcorner \llcorner \llcorner$  from the configuration menu and press  $\text{P}$  which will cause the BA567E-SS Counter to display  $\text{0000}$  with one digit flashing. The flashing digit may be adjusted using the  $\blacktriangledown$  and  $\blacktriangle$  push buttons, when set as required operating the  $\text{P}$  button will transfer control to the next digit. When all the digits have been adjusted press  $\text{E}$  to return to the  $\llcorner \llcorner \llcorner$  prompt. The revised security code will be activated when the BA567E-SS Counter is returned to the display mode.

Please contact BEKA associates sales department if the security code is lost.

### 5.23 Reset configuration to factory defaults:

#### RESET DEF

This function returns the BA567E-SS Counter to the factory defaults shown in section 5.0. To prevent accidental use the request must be confirmed by entering *5urE* before the configuration change will be executed.

Select *RESET DEF* from the configuration menu and press **[P]** the instrument will display *0000* with the first digit flashing. To confirm the instruction to reset all the configuration functions to factory defaults *5urE* must be entered. Using the **[▼]** or **[▲]** button set the first flashing digit to *5* and press **[P]** to transfer control to the second digit which should be set to *u*. When *5urE* has been entered pressing the **[E]** button will reset all the configuration functions to the factory default settings and zero both the total display and the grand total. While resetting the BA567E-SS Counter will display *- - - - -* before automatically returning to the display mode when the operation is complete.

### 5.24 Display overflow

The BA567E-SS Counter total has a maximum display range of *-9999999* to *99999999* when shown on the eight digit upper display. If this range is exceeded the display will be as shown below with all of the decimal points flashing:

Underrange      *-9.9.9.9.9.9*

Overrange      *9.9.9.9.9.9.9*

When the total is shown on the lower six digit display the maximum display range is *-99999* to *999999*.

When a total overflow occurs the actual total may be obtained from the instrument's grand total display which has sixteen digit - see 2.3.

To prevent future total display overflows occurring the total scale factor *SCALE.E* and the position of the decimal point in the total display *dP* should be reviewed.

## 6. CONFIGURATION EXAMPLE

A BA567E-SS Counter is required to display the total number of strokes that a reciprocating pump makes in thousands of strokes on the larger upper display and to show the speed of pumping in strokes per hour on the lower display. The stroke sensor is a proximity detector which produces four pulses per stroke. The total display is only to be resettable by an external contact, not from the BA567E-SS Counter front panel. Similarly the grand total is not to be resettable from the BA567E-SS Counter front panel. To simplify reading the BA567E-SS display is to be updated every 3 seconds and to prevent tampering the instrument configuration menu is to be protected by security code 1209.

The BA567E-SS may be configured on-site without disconnection from the power supply or from the proximity detector. This example assumes that the BA567E-SS initially has default factory configuration.

If after accessing the configuration menu the interval between operating any front panel push button exceeds one minute the BA567E-SS will automatically return to the display mode and any configuration changes will not be stored in permanent memory. When making multiple changes it is therefore sensible to occasionally return to the display mode to save the changes that have already been made.

### Step 1 Enter the configuration menu

Put the BA567E-SS Counter in the configuration mode by simultaneously pressing the **[P]** and **[E]** push buttons. Assuming a security code has not already been entered the instrument will respond by displaying **INPUL** which is the first parameter in the configuration menu. See Fig 8.

### Step 2 Select the type of inputs

With **INPUL** displayed; press **[P]** to reveal the **INPUL.TYPE** submenu and press **[P]** again to enter the function. Using the **[▼]** or **[▲]** button select **PRDET**, the input for a 2-wire proximity detector and then return to the **INPUL** prompt in the configuration menu by pressing **[E]** twice. A proximity detector requires energising therefore terminals 3 and 4 of the BA567E-SS should be linked together.

### Step 3 Select display update

To aid reading the display the BA567E-SS is only to be updated every 3 seconds.

Select **UPDRT** from the configuration menu and press **[P]**. Using the **[▼]** or **[▲]** button select **3** and press **[E]** to return to the **UPDRT** prompt in the configuration menu.

### Step 4 Define function of upper display

In the example the total number of strokes is required on the larger eight digit upper display.

Select **DISP-1** from the configuration menu and press **[P]** which will reveal if the upper display is showing **RTT** or **EXTRL**. Using the **[▼]** or **[▲]** button select **EXTRL** followed by the **[E]** button to enter the selection and return to the configuration menu.

### Step 5 Activate lower rate display

A rate display is required so the lower display must be activated.

Select **DISP.LR.2** from the main menu and press **[P]** to show the existing setting. Using the **[▼]** or **[▲]** button select **on** followed by **[E]** to enter the selection and return to the configuration menu.

### Step 6 Position of decimal point

In this example the BA567E-SS is required to display total and rate with no decimal points.

Select **DP.** from the configuration menu and press **[P]**. The BA567E-SS will show and identify the total display with all the digits activated. Using the **[▼]** or **[▲]** button position the decimal point to the right of the least significant digit i.e. not visible.

Operating the **[P]** button will show and identify the rate display with all the digits activated. Again using the **[▼]** or **[▲]** button position the decimal point to the right of the least significant digit i.e. not visible.

Finally press **[E]** to return to the configuration menu.

**Step 7 Enter the total scale factor**

In this example the proximity detector produce four pulses per pump stroke. The BA567E-SS is required to display thousands of pump strokes therefore the total scale factor `SCALE` should be set to  $(4 \times 1000) = 4000$ .

Select `SCALE` from the configuration menu and press `P` to view the current value with one digit flashing. Use the `▼` or `▲` button to adjust the flashing digit and the `P` button to transfer control to the next digit and to the decimal point. Enter `40000` and return to the `SCALE` prompt in the configuration menu by pressing `E`.

**Step 8 Enter the rate scale factor**

The proximity detector produces four pulses per pump stroke and the rate display is required in strokes per hour, therefore the rate scale factor `SCALEr` should be set to 4.0.

Select `SCALEr` from the configuration menu and press `P` to view the current value with one digit flashing. Use the `▼` or `▲` button to adjust the flashing digit and the `P` button to transfer control to the next digit and to the decimal point. Enter `40` and return to the `SCALEr` prompt in the configuration menu by pressing `E`.

**Step 9 Set the display timebase**

In this example the rate display is required in pump strokes per hour. Select `t-bASE` from the configuration menu and press `P` to reveal the current setting. Using the `▼` or `▲` button scroll through the three options and select `t-b-3600`. Return to the `t-bASE` prompt in the configuration menu by pressing `E`.

**Step 10 Adjust the rate display filter**

The rate display filter parameters should be adjusted experimentally after installation to provide a stable rate display with an acceptable step response.

During commissioning it is recommend that initially the second digit of the rate parameters is set to 0 (step response off) and the first digit (amount of filtering) is adjusted to provide acceptable rate display stability.

The second digit should then be increased until acceptable rate display stability is once again achieved.

To adjust the filter parameters select `FILTER` from the main menu and press `P` to reveal the current setting. The first digit will be flashing and may be adjusted using the `▼` or `▲` button. The `P` button will transfer control to the second digit. When both are set as required, return to the `FILTER` prompt in the configuration menu by pressing `E`.

**Note:** While adjusting the filter, the rate is shown on the lower display so that stability can be assessed.

**Step 11 Define the security code**

Defining an access security code prevents unauthorised access to the configuration menu. Select `CODE` in the configuration menu and press `P` which will reveal the existing security code with the first digit flashing. Enter the new code 1209 using the `▼` or `▲` button to adjust the flashing digit and the `P` button to transfer control to the next digit. When the new code has been entered, press `E` to return to the configuration menu.

**Step 12 Return to the display mode**

Following completion of configuration, return the BA567E-SS to the display mode by pressing `E`. The instrument will display `dRtR` followed by `SRUE` while the configuration changes are stored in permanent memory.

The BA567E-SS was assumed to initially have factory default configuration, therefore the counting edge, counting direction, local total and local grand total resets were not reconfigured as they already complied with the requirements for this example.

During commissioning the debounce and filter functions may need adjustment to obtain a stable display.

## 7. MAINTENANCE

### 7.1 Fault finding during commissioning

If a BA567E-SS Counter fails to function during commissioning the following procedure should be followed:

Symptom	Cause	Check:
No display	No power supply, or incorrect wiring. Note: Terminals 2, 6 & RS2 are interconnected within the instrument.	That there is between 10 and 30V on terminals 1 & 2 with terminal 1 positive.
Counter is receiving power but pulse input indicator not rotating.	No input pulses, incorrect input configuration, incorrect linking of terminals 3 & 4.	Input configuration.  Linking of terminals 3 & 4.  That input signal polarity is correct.
Pulse input indicator rotating but incorrect rate display.	Incorrect rate display calibration	SCALE t-bASE
Pulse indicator rotating but incorrect total display.	Incorrect total display calibration.  Remote reset switch contacts closed.	SCALE  That RESET annunciator is not activated. If it is, check reset wiring and switch.
Unstable rate display	Noisy pulse input signal	Eliminate source of electrical noise. Increase debounce and/or display filter.
Unable to enter configuration menu.	Incorrect security code	That the correct security code is being used.  Contact BEKA if code is lost.
Optional 4/20mA or pulse output do not function	Output has been disabled following configuration change	Re-enable output
Optional alarms do not function	Alarms have been disabled following configuration change.	Re-enable both alarms.

### 7.2 Fault finding after commissioning

#### ENSURE PLANT SAFETY BEFORE STARTING MAINTENANCE

**Live maintenance is permitted on intrinsically safe equipment installed in a hazardous area, but only certified test equipment should be used unless a gas clearance certificate is available.**

If a BA567E-SS Counter fails after it has been functioning correctly, the following table may help to identify the cause of the failure.

Symptom	Cause	Check:
No display	No power supply.	That there is between 10 and 30V on terminals 1 & 2 with terminal 1 positive
Pulse input indicator not rotating.	No input pulses	Output from sensor. Wiring between sensor and BA567E-SS Counter.
Unstable rate display	Noisy pulse input signal	Locate source of electrical noise, or increase debounce and rate display filter.

If this procedure does not reveal the cause of the fault, it is recommended that the instrument is replaced.

### 5.3 Servicing

We recommend that faulty BA567E-SS Counters are returned to BEKA associates or to our local agent for repair.

### 5.4 Routine maintenance

The mechanical and electrical condition of the instrument should be regularly checked. Inspection frequency should be adjusted to suit the environmental conditions.

### 5.5 Guarantee

Instruments which fail within the guarantee period should be returned to BEKA associates or our local agent. It is helpful if a brief description of the fault symptoms is provided.

### 5.6 Customer comments

BEKA associates is always pleased to receive comments from customers about our products and services. All communications are acknowledged and whenever possible, suggestions are implemented.

## 8. ACCESSORIES

Accessories for the BA567E-SS Counter are shown below, all except the scale card are factory fitted and should be specified when the instrument is ordered:

Scale card  
 Tag number  
 Backlight <sup>1</sup>  
 Isolated pulse output <sup>2</sup>  
     or  
 Isolated 4/20mA output <sup>2</sup>  
     or  
 Isolated dual alarms <sup>2</sup>

### Notes:

1. Internally powered
2. Only one of the three output options can be fitted to a BA567E-SS.

### 8.1 Scale card

The BA567E-SS has a window on the right hand side of the display through which to view a scale card showing the units of measurement such as Strokes or Metres. New Counters are fitted with a scale card showing the units of measurement specified when the instrument was ordered, if the units are not specified a blank scale card will be fitted. A pack of scale cards pre-printed with common units of measurement is available as an accessory. These can easily be fitted on-site to the Counter without opening the instrument enclosure or removing it from the panel, See section 4.5 of this instruction manual.

Custom scale cards for applications requiring less common units of measurement are also available.

### 8.2 Tag information

A tag number or application information can be printed onto the rear panel adjacent to the terminals. This information is not visible from the front of the instrument after installation.

### 8.3 Alarms

**Only one of the following accessories may be fitted: dual alarms, pulse output or 4/20mA output.**

The BA567E-SS Counter can be supplied with factory fitted dual solid state single pole alarm outputs that may be independently configured as high or low, rate or total alarms with normally open or normally closed outputs.

Configurable functions for each alarm include adjustable setpoint, alarm delay time and alarm silence time. Hysteresis may be applied to rate alarms.

### CAUTION

**Alarm outputs should not be used for critical safety applications such as a shut down system.**

When the BA567E-SS power supply is turned off or disconnected, alarm outputs will open irrespective of whether normally open or normally closed outputs have been selected. When designing a system an open output should therefore be chosen for the alarm condition.

Alarm annunciators on the instrument display indicate the status of each alarm. If an alarm delay or silence time has been selected the annunciator will flash during the delay or silence period.

The BA567E-SS internal counters are up-dated and compared with the alarm setpoint twice per second, irrespective of the display update time selected. This may result in an alarm being delayed for up to half a second after the rate or total has exceeded the setpoint.

#### 8.3.1 Solid state output

Each alarm has a galvanically isolated single pole solid state switch output as shown in Fig 14. The outputs are polarised and current will only flow in one direction. Terminals A1 and A3 should be connected to the positive side of the supply.

$$\begin{aligned} R_{on} &= \text{less than } 5\Omega + 0.7V \\ R_{off} &= \text{greater than } 1M\Omega \end{aligned}$$

**Note:** Because of the series protection diode some test meters may not detect a closed alarm output

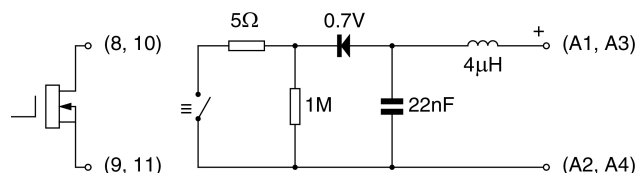


Fig 9 Equivalent circuit of each alarm output

The solid state output of each alarm may be used to switch any circuit with parameters equal or less than:

$$\begin{aligned} V &= 30V \\ I &= 200mA \end{aligned}$$

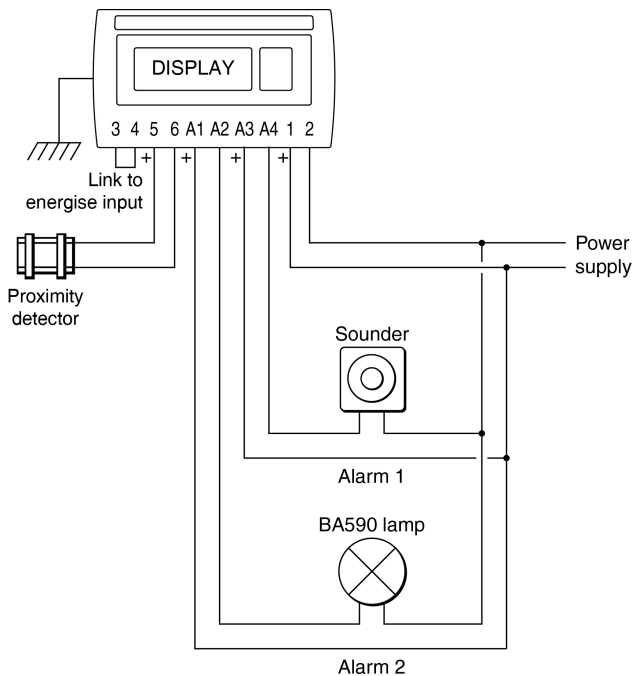


Fig 10 Typical alarm application

### 8.3.2 Configuration summary

When a BA567E-SS Counter is supplied with alarms the configuration menu is extended as shown in Fig 11. Each alarm may be configured to operate on the rate or total display.

For simplicity Fig 11 only shows the configurable functions on the rate option of alarm AL1, the total options is identical except that the total alarms can not have hysteresis. Configuration of alarm AL2 is identical to alarm AL1.

The following table summarises each of the alarm configuration functions and includes a cross reference to more detailed information. Again only the functions on alarm AL1 are listed.

Display	Summary of function
<b>EnbL</b>	<b>Alarm enable</b> Enables or disables the alarm without changing the alarm parameters. See section 8.3.3
<b>tYPE</b>	<b>Type of alarm</b> Defines whether the alarm operates on the rate or total display. See section 8.3.4
<b>SP Ir</b> or <b>SP It</b>	<b>Alarm setpoint 1</b> Adjusts the alarm setpoint. The alarm is activated when the rate or total display equals the setpoint. <b>Note:</b> SP Ir is displayed for a rate alarm and SP It for a total alarm. See section 8.3.5
<b>Hi.Lo</b>	<b>Alarm function</b> Defines whether the alarm has a high or low function. See section 8.3.6
<b>no.nC</b>	<b>Normally open or normally closed output.</b> Determines whether the single pole alarm output is open or closed in the non-alarm condition. See section 8.3.7
<b>HSt.r</b>	<b>Hysteresis</b> Adjusts the alarm hysteresis. Only available on a rate alarm. See section 8.3.8
<b>dELt</b>	<b>Alarm delay time</b> Adjusts the delay between the display equalling the alarm setpoint and the alarm output being activated. See section 8.3.9
<b>S, L</b>	<b>Alarm silence time</b> Defines the time that the alarm output remains in the non-alarm condition following acceptance of an alarm. See section 8.3.10
<b>FLSH</b>	<b>Flash display when alarm occurs</b> When enabled, alternates the rate or total display between process value and alarm reference RL1 or RL2 when an alarm output is activated. See section 8.3.11
<b>ALSP</b>	<b>Access setpoint</b> Sub-menu that enables direct access to the alarm setpoints from the display mode and defines a separate security code. See section 8.3.12



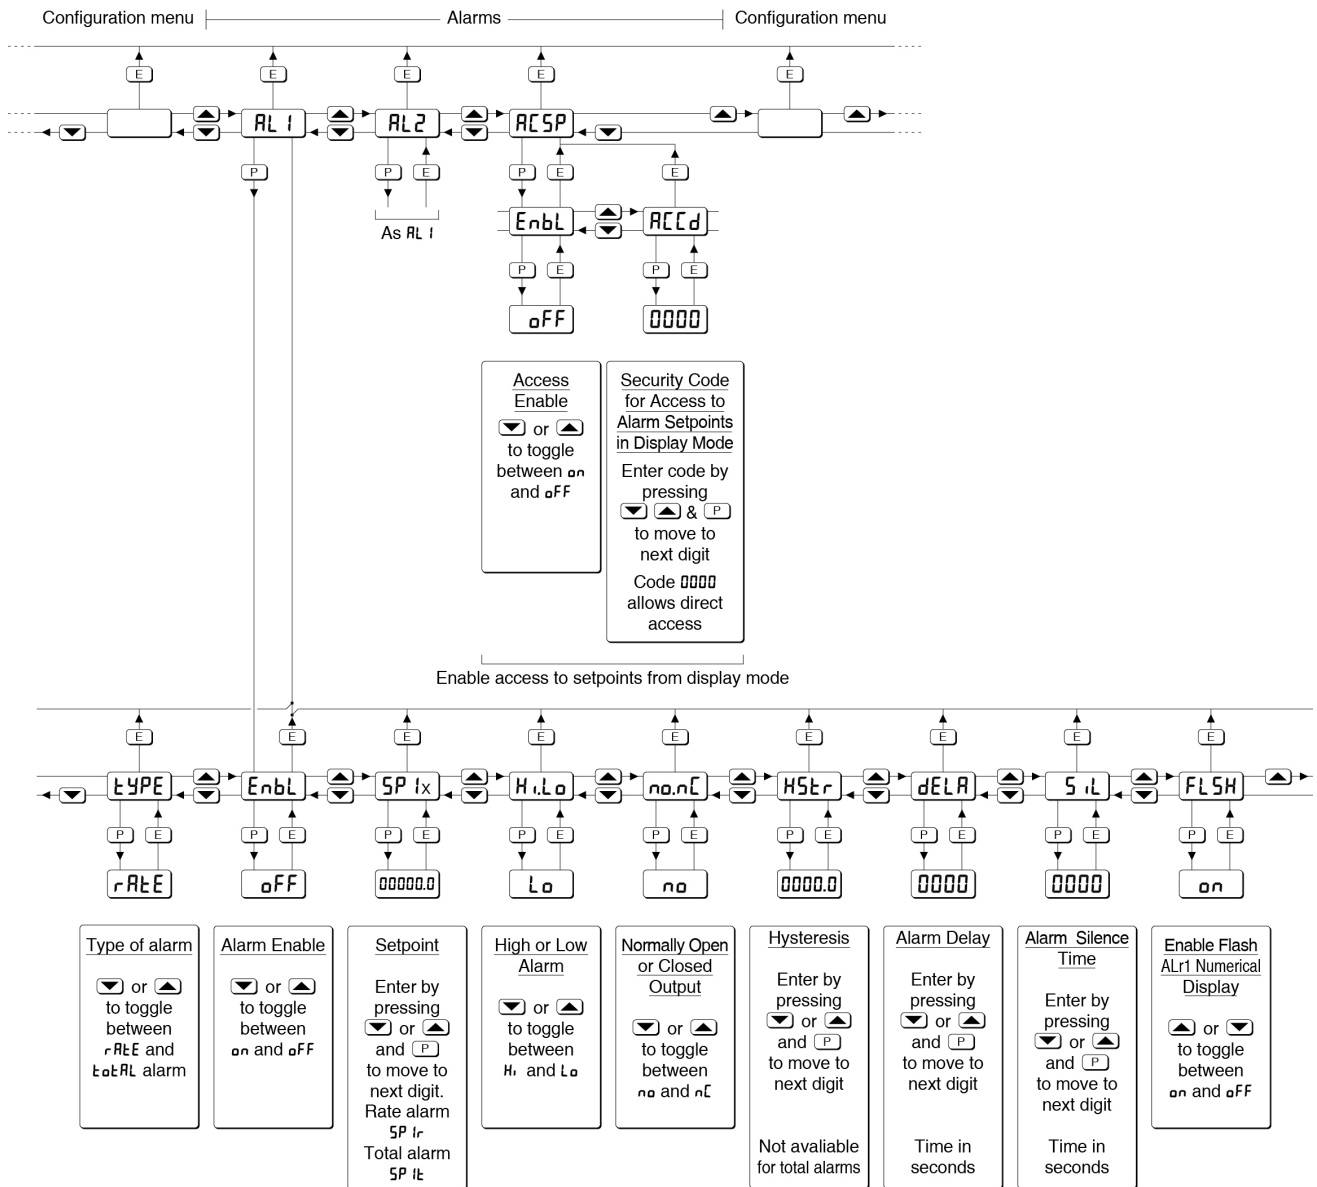


Fig 11 Alarm Configuration Functions in Configuration Menu

### 8.3.3 Alarm enable: EnbL

This function allows the alarm to be enabled or disabled without altering any of the alarm parameters. Using the ▼ or ▲ push button select RL1 or RL2 from the configuration menu and press P to reach EnbL in the alarm sub-menu. Pressing P will then reveal the existing setting. The function can be changed by pressing the ▼ or ▲ push button followed by the E button to return to the alarm sub-menu.

### 8.3.4 Type of alarm: TYPE

Alarm 1 and Alarm 2 are totally independent, both may be rate or total alarms, or one may be conditioned for rate and the other for total.

Using the ▼ or ▲ push button select TYPE from the selected alarm sub-menu and press P to check or change the function. The ▼ or ▲ push button will toggle the selection between rALtE and tALtRL, when set as required press the E button to return to the alarm sub-menu.

**Note:** When TYPE is changed, the alarm configuration is automatically reset to the default values and the alarm is disabled. It must therefore be reconfigured before use.

### 8.3.5 Setpoint adjustment: $SP_{1r}$ & $SP_{2r}$

The rate alarm setpoints  $SP_{1r}$  and  $SP_{2r}$  may be positioned anywhere between -99999 and 999999, and the total alarm setpoint  $SP_{1t}$  and  $SP_{2t}$  anywhere between -9999999 and 99999999.

All the setpoints are adjusted in the same way, for example, to adjust the setpoint of Alarm 1 which has been configured to operate on the rate display. Using the  $\blacktriangledown$  or  $\blacktriangle$  push button select  $SP_{1r}$  in the  $RL1$  sub-menu and press  $\text{P}$  which will reveal the existing setpoint with one digit flashing. The required setpoint can be entered using the  $\blacktriangledown$  or  $\blacktriangle$  push button to adjust the flashing digit and the  $\text{P}$  button to transfer control to the next digit. When set as required press  $\text{E}$  to enter the value and return to the  $SP_{1r}$  prompt in the alarm 1 sub-menu.

### 8.3.6 Alarm function: $Hi.Lo$

Alarm 1 and Alarm 2 are totally independent, both may be Hi or Lo, or one may be conditioned as a Hi alarm and the other as a Lo alarm.

Using the  $\blacktriangledown$  or  $\blacktriangle$  push button select  $Hi.Lo$  from the selected alarm sub-menu and press  $\text{P}$  to check or change the function. The  $\blacktriangledown$  or  $\blacktriangle$  push button will toggle the alarm function between  $Hi$  and  $Lo$ , when set as required, press the  $\text{E}$  button to return to the  $Hi.Lo$  prompt in the alarm sub-menu.

### 8.3.7 Alarm output status: $no.nc$

Each single pole alarm output may be open or closed in the non-alarm condition. When the BA567E-SS power supply is turned off or disconnected, the alarm output(s) will open irrespective of whether normally open or normally closed outputs have been selected. Therefore, when designing an alarm system normally closed  $nc$  should be selected so that the output opens when an alarm occurs or if the power supply fails.

Using the  $\blacktriangledown$  or  $\blacktriangle$  push button select  $no.nc$  from the selected alarm sub-menu and press  $\text{P}$  to check or change the function. The  $\blacktriangledown$  or  $\blacktriangle$  push button will toggle the contact status between  $no$  and  $nc$ , when set as required, press the  $\text{E}$  button to return to the  $no.nc$  prompt in the alarm sub-menu

### 8.3.8 Hysteresis: $H5tr$

Hysteresis is only available on rate alarms so the  $H5tr$  function only appears in the configuration sub-menu when alarm  $TYPE$  has been set to  $rate$ . During configuration hysteresis is shown in the units of rate previously configured for the rate display.

Using the  $\blacktriangledown$  or  $\blacktriangle$  push button select  $H5tr$  in the selected alarm sub-menu and press  $\text{P}$  which will reveal the existing hysteresis with one digit flashing.

The required hysteresis can be entered using the  $\blacktriangledown$  or  $\blacktriangle$  push button to adjust the flashing digit and the  $\text{P}$  button to transfer control to the next digit. When set as required press  $\text{E}$  to enter the value and return to the  $H5tr$  prompt in the alarm sub-menu.

e.g. A BA567E-SS Counter configured to display a rate of 0 to 5000, with a high alarm set at 4000 and hysteresis of 100 will perform as follows:

High alarm will be activated when rate equals or exceeds 4000, but will not reset until the rate falls below 3900.

### 8.3.9 Alarm delay: $dELR$

This function enables activation of the alarm output to be delayed for a fixed time following the alarm condition occurring. The delay can be set in 1 second increments up to 3600 seconds. If a delay is not required zero should be entered.

To adjust the delay select  $dELR$  using the  $\blacktriangledown$  or  $\blacktriangle$  push button in the selected alarm sub-menu and press  $\text{P}$  which will reveal the existing delay time in seconds with one digit flashing. The required delay time can be entered using the  $\blacktriangledown$  or  $\blacktriangle$  push button to adjust the flashing digit and the  $\text{P}$  button to transfer control to the next digit. When set as required press  $\text{E}$  to enter the value and return to the  $dELR$  prompt in the alarm sub-menu.

The alarm annunciator will start flashing immediately an alarm occurs and will continue for the delay time, after which the alarm output will be activated and the alarm annunciator will be permanently activated.

### 8.3.10 Alarm silence time: $S_L$

The alarm silence function is primarily intended for use in small installations where the alarm output directly operates an annunciator such as a sounder. When the alarm silence time is set to any figure other than zero, the  $\text{P}$  push-button becomes an alarm accept button.

After an alarm has occurred, operating the  $\text{P}$  button will cause the alarm output to revert to the non-alarm condition for the alarm silence time. When an alarm is silenced the alarm annunciator will flash until the silence time expires.

To adjust the alarm silence time select  $S_L$  using the  $\blacktriangledown$  or  $\blacktriangle$  push button in the selected alarm sub-menu and press  $\text{P}$  which will reveal the existing alarm silence time in seconds with one digit flashing. The required silence time can be entered using the  $\blacktriangledown$  or  $\blacktriangle$  push button to adjust the flashing digit and the  $\text{P}$  button to transfer control to the next digit. When set as required press  $\text{E}$  to enter the value and return to the  $S_L$  prompt in the alarm sub-menu.

### 8.3.11 Flash display when alarm occurs: FL5H

In addition to the two alarm annunciators on the left hand side of the BA567E-SS Counter display which show the status of both alarms, this function provides an even more conspicuous indication that an alarm condition has occurred.

When enabled, this function alternates the rate or total display between the numerical value and the alarm identification  $RL1$  or  $RL2$  when an alarm occurs.

Using the  $\blacktriangledown$  or  $\blacktriangle$  push button select FL5H from the selected alarm sub-menu and press  $P$  to check or change the function. The  $\blacktriangledown$  or  $\blacktriangle$  push button will toggle the function between  $OFF$  and  $ON$ , when set as required, press the  $E$  button to return to the FL5H prompt in the alarm sub-menu.

### 8.3.12 Access Setpoint: RE5P

This function activates a separate menu that provides direct access to the alarm setpoints from the display mode by simultaneously operating the  $P$  and  $\blacktriangle$  buttons. An operator can therefore adjust the alarm setpoints without having access to the configuration and alarm sub-menus. Protection against unauthorised or accidental adjustment is provided by a separate security access code.

Using the  $\blacktriangledown$  or  $\blacktriangle$  push button select RE5P from the configuration menu and press  $P$  to reach the enable function  $EnbL$ . Pressing  $P$  will reveal the existing setting which can be toggled between  $ON$  and  $OFF$  by pressing the  $\blacktriangledown$  or  $\blacktriangle$  push button. When set as required, press the  $E$  button to return to the  $EnbL$  prompt from which a separate security access code can be entered using the  $REEd$  function which can be selected using the  $\blacktriangledown$  or  $\blacktriangle$  push button.

To enter a new security code select  $REEd$  from the sub-menu and press  $P$  which will cause the BA567E-SS Counter to display 0000 with one digit flashing. The flashing digit may be adjusted using the  $\blacktriangledown$  and  $\blacktriangle$  push buttons, when set as required operating the  $P$  button will transfer control to the next digit. When all the digits have been adjusted press  $E$  to return to the  $REEd$  prompt. The revised security code will be activated when the BA567E-SS Counter is returned to the display mode. Default security access code 0000 will disable the security code allowing direct access to the setpoints in the display mode by pressing the  $P$  and  $\blacktriangle$  buttons simultaneously.

Please contact BEKA associates sales department if the security code is lost.

### 8.3.13 Adjusting alarm setpoints from the display mode

Access to the two alarm setpoints from the BA567E-SS Counter's display mode is obtained by operating the  $P$  and  $\blacktriangle$  push buttons simultaneously as shown in Fig 12. If the setpoints are not protected by a security code the alarm setpoint prompt  $SP1r$  or  $SP1t$  will be displayed depending upon whether a rate or total alarm has been configured. If the setpoints are protected by a security code,  $Code$  will be displayed first. Pressing  $P$  again will allow the alarm setpoint security code to be entered digit by digit using the  $\blacktriangledown$  or  $\blacktriangle$  button to adjust the flashing digit and the  $P$  push button to move control to the next digit. If the correct code is entered pressing  $E$  will then cause alarm setpoint prompt  $SP1x$  to be displayed. If an incorrect security code is entered, or a button is not pressed within ten seconds, the instrument will automatically return to the display mode.

Once within the menu pressing the  $\blacktriangledown$  or  $\blacktriangle$  buttons will toggle the display between the two alarm setpoint prompts  $SP1x$  and  $SP2x$ .

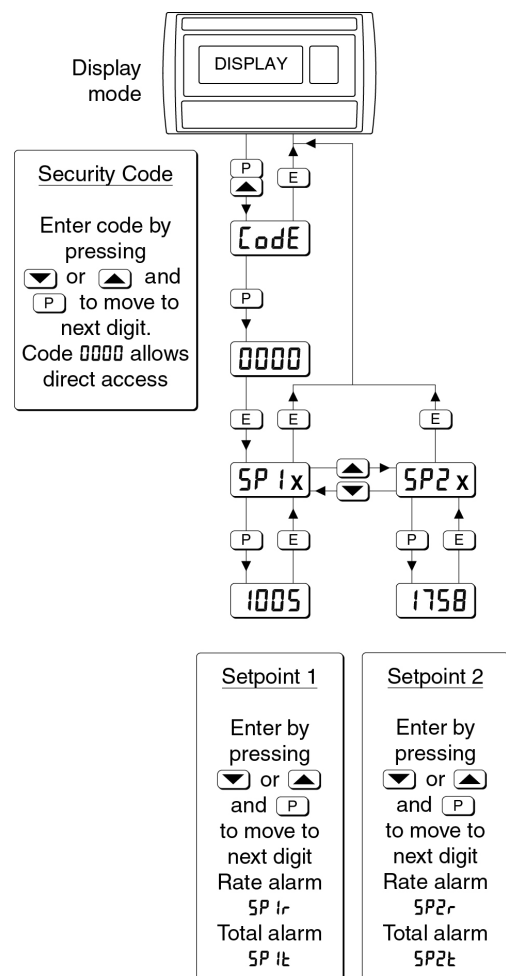


Fig 12 Setpoint adjustment from the display mode

To adjust an alarm setpoint select  $5P\ 1x$  or  $5P\ 2x$  and press **[P]** which will reveal the current setting. The flashing digit of the setpoint may be adjusted using the **[▼]** and **[▲]** push buttons and the **[P]** button to move control to the next digit. When the required setpoint has been entered, pressing **[E]** will return the display to the  $5P\ 1x$  or  $5P\ 2x$  prompt from which the other setpoint may be selected, or the instrument may be returned to the display mode by pressing **[E]** again.

**Note:** Direct access to the alarm setpoints from the display mode is only available when the  $RC5P$  menu is enabled - see section 8.3.12

## 8.4 Pulse output

**Only one of the following accessories may be fitted: dual alarms, pulse output or 4/20mA output.**

The BA567E-SS Counter can be supplied with a factory fitted opto-isolated solid state pulse output. The output is an open collector having the following electrical parameters:

$R_{on}$	=	$60\Omega + 3V$
$R_{off}$	=	1M
$I_{max}$	=	10mA

The output pulse may be a duplicate of the input pulse for re-transmission applications, or it may be derived from the total display. When derived from the total display the output pulse frequency may be divided and the output pulse width defined.

The retransmitted RTx annunciator on the instrument display shows the status of the retransmitted pulse output. Annunciator activation depends upon the setting of  $5OUTC$  in the pulse output configuration menu.

### SCALE#

Annunciator activated each time pulse output open collector is *on*, i.e.  $R_{on}$  is less than  $60\Omega + 3V$ .

### drFEE

Annunciator continuously activated

### 8.4.1 System design

The BA567E-SS Counter's optional pulse output is a passive circuit i.e. not powered, but it is totally isolated from all other Counter circuits. Terminals P1 and P2 may be connected to any other instrument with an open collector input.

Fig 13 shows how a voltage pulse may be generated that could be used to drive a remote counter. The positive terminal of the pulse output circuit P1 is connected to the BA567E-SS Counter's positive supply terminal 1 at the instrument. When an output pulse occurs and the open collector output 'closes', P2 is connected to P1 and a pulse current flows through resistor R1. The current flowing in the circuit is determined by resistor R1 which should be chosen to limit the pulse output current to less than 10mA. For a 24V supply R1 should be greater than 2,200 $\Omega$ .

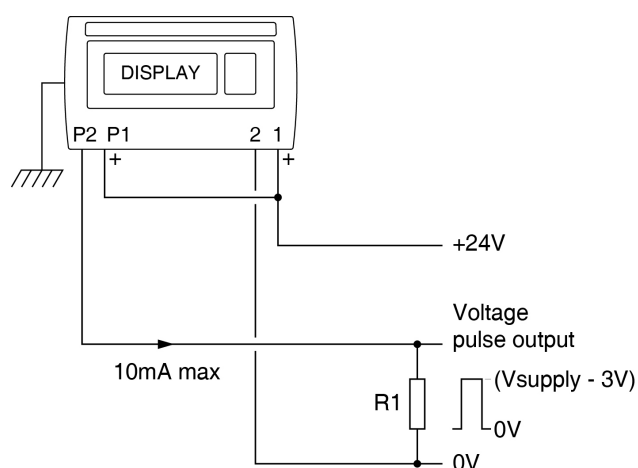


Fig 13 Generating a voltage pulse output

### 8.4.2 Configuration

When a BA567E-SS Counter is supplied with an optional pulse output the configuration menu is extended as shown in Fig 14.

The pulse output sub-menu allows the source of the output pulse to be selected in the *Source* sub-function. For re-transmission applications the output pulse may be a synchronous duplicate of the input pulse by selecting *direct* in the *Source* sub-function.

Selecting *SCALed* derives the output pulse from the total display and introduces two additional functions, *divide* and *duration on* to the sub-menu allowing the output pulse frequency to be divided and the output pulse width (duration) to be defined. The total display is read every half second and any increase since the last reading copied into the pulse output counter. After dividing by the *divide* function, pulses of width defined by the *duration on* function are asynchronously output from this counter as quickly as possible.

If the *divide* and *duration on* functions are configured such that the output pulse frequency with the specified pulse width can not be output in real time, the number of pulses will be stored and transmitted at the maximum possible speed.

When the total display is reset to zero or the power supply to the BA567E-SS Counter is disconnected or turned off, any stored pulses will not be retained

### 8.4.3 Access Pulse output sub-menu: *PULSE oP*

Access to the BA567E-SS Counter configuration menu as described in section 5.2. Using the  $\blacktriangledown$  and  $\blacktriangle$  push buttons scroll through the menu until *PULSE oP* is displayed, pressing **P** will then access the pulse output sub-menu which is shown in Fig 14.

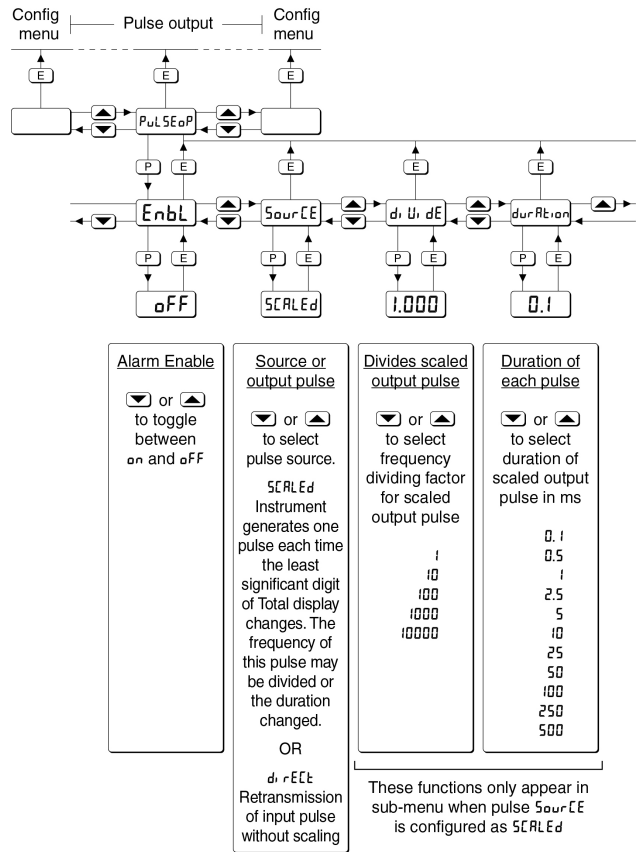


Fig 14 Pulse output configuration sub-menu







### 8.4.4 Enable pulse output: *EnbL*

This function allows the pulse output to be disabled or enabled without altering any of the pulse output parameters. Using the  $\blacktriangledown$  or  $\blacktriangle$  push button select *EnbL* in the pulse output sub-menu and press **P** to reveal the existing setting *on* or *oFF*. The function can be changed by pressing the  $\blacktriangledown$  or  $\blacktriangle$  push button followed by the **E** button to return to *EnbL* prompt.

#### 8.4.5 Source of pulse output: *Source*

The output pulse may be derived from:







<i>direct</i>	Output is a duplicate of the input pulse.
<i>SCALed</i>	Output is derived from the total display. When <i>SCALed</i> is selected two additional functions, <i>divi de</i> and <i>duration</i> , appear in the pulse output sub-menu.

Using the  or  push button select *Source* in the pulse output sub-menu and press  to reveal the existing pulse source. The function can be changed by pressing the  or  push button followed by the  button to return to *Source* prompt.

#### 8.4.6 Divide output pulse frequency: *divi de*

When the output pulse is derived from the total display the output pulse frequency may be divided by:

1  
10  
100  
1000  
10000







Using the  or  push button select *divi de* in the pulse output sub-menu and press  to reveal the existing divisor. The value can be changed by pressing the  or  push button to select the required value followed by the  button to return to *divi de* prompt.

**Note:** This function only appears in the sub-menu when the output pulse is derived from the total display.

#### 8.4.7 Output pulse width: *duration*

When the output pulse is derived from the total display, the pulse width is defined by this function. One of 11 pulse widths may be selected in milliseconds:

0.1  
0.5  
1  
2.5  
5  
10  
25  
50  
100  
250  
500

Using the  or  push button select *duration* in the pulse output sub-menu and press  to reveal the existing pulse duration. The value can be changed by pressing the  or  push button to select the required value followed by the  button to return to *duration* prompt.

**Note:** This function only appears in the pulse output sub-menu when the output pulse is derived from the total display.

## 8.5 4/20mA output

**Only one of the following accessories may be fitted: dual alarms, pulse output or 4/20mA output.**

The BA567E-SS Counter can be supplied with a factory fitted galvanically isolated 4/20mA current sink which may be configured to represent the rate or total display.

### 8.5.1 System design

The optional 4/20mA output is a passive current sink i.e. not powered, but it is totally isolated from all other Counter circuits. It is effectively a 2-wire 4/20mA transmitter requiring a minimum supply of 5V with the current being controlled by the BA567E-SS rate or total display. Terminals C1 and C3 may be directly connected to any other instrument which will accept a 4/20mA loop powered transmitter input.

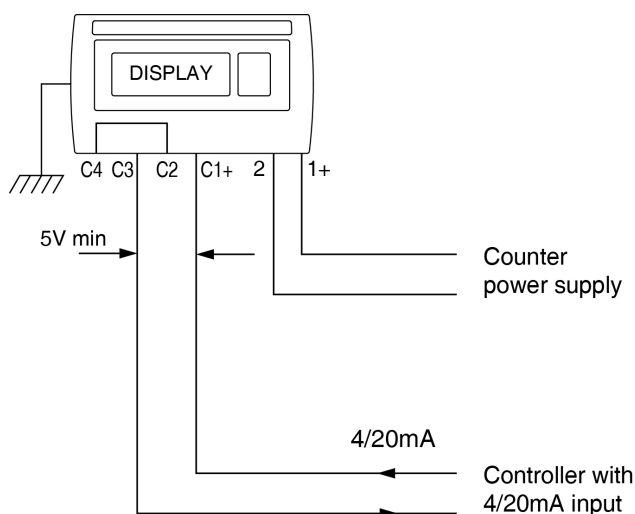


Fig 15 Application of 4/20mA output

### 8.5.2 Configuration

When a BA567E-SS Counter is supplied with an optional 4/20mA output the configuration menu is extended as shown in Fig 16. The 4/20mA output sub-menu is accessed via the 4-20 oP function.

The 4/20mA output sub-menu allows the 4/20mA output to be controlled by the rate or the total display.

### 8.5.3 Access 4/20mA output sub-menu: 4-20 oP

Access the BA567E-SS Counter configuration menu as described in section 5.2. Using the  $\blacktriangleleft$  and  $\blacktriangleright$  push buttons scroll through the menu until 4-20 oP is displayed, pressing  $\text{P}$  will then access the 4/20mA output sub-menu which is shown in Fig 21.

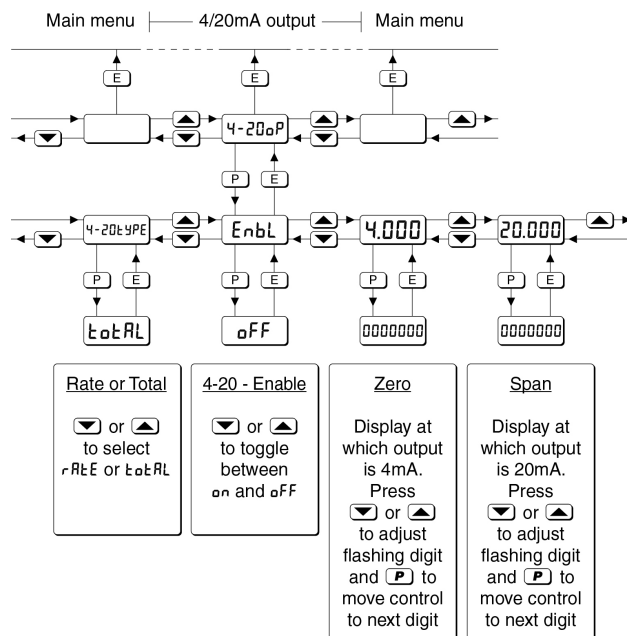


Fig 16 4/20mA output configuration sub-menu

### 8.5.4 Enable 4/20mA output: EnbL

This function allows the 4/20mA output to be disabled or enabled without altering any of the 4/20mA output parameters. Using the  $\blacktriangleleft$  or  $\blacktriangleright$  push button select EnbL in the 4-20 oP sub-menu and press  $\text{P}$  to reveal the existing setting on or oFF. The function can be changed by pressing the  $\blacktriangleleft$  or  $\blacktriangleright$  push button followed by the  $\text{E}$  button to return to EnbL prompt.

**Note 1:** When the 4/20mA output is disabled by selecting oFF, the output is a constant 3.5mA irrespective of the instrument display.

### 8.5.5 Select rate or total source: 4-20 tYPE

The 4/20mA output current can represent the BA567E-SS Counter's rate or total display and this should be defined before any other 4/20mA current output functions are configured.

Using the  $\blacktriangleleft$  or  $\blacktriangleright$  push button select 4-20 tYPE in the 4/20mA output sub-menu and press  $\text{P}$  to reveal the existing setting tOtRL or rRtE. The function can be changed by pressing the  $\blacktriangleleft$  or  $\blacktriangleright$  push button followed by the  $\text{E}$  button to return to 4-20 tYPE prompt.

**Note :** If the controlling source of the 4/20mA output is changed i.e. from rate to total, the 4/20mA output will be disabled and the output will be a constant 3.5mA irrespective of the instrument display. The 4/20mA output must always be re-enabled and reconfigured following the controlling source being changed.

### 8.5.6 Display which corresponds to 4mA output: 4.000

The BA567E-SS Counter display which corresponds to a 4.000mA output current is defined by this function. Using the  $\nabla$  or  $\blacktriangle$  push button select 4.000 in the 4/20mA output sub-menu and press  $\text{P}$  to reveal the existing rate or total display with one digit flashing. The required display can be entered using the  $\nabla$  or  $\blacktriangle$  push button to adjust the flashing digit and the  $\text{P}$  button to transfer control to the next digit. When set as required press  $\text{E}$  to enter the value and return to the 4.000 prompt in the 4/20mA output sub-menu.

### 8.5.7 Display which corresponds to 20mA output: 20.000

The BA567E-SS Counter display which corresponds to a 20.000mA output current is defined by this function. Using the  $\nabla$  or  $\blacktriangle$  push button select 20.000 in the 4/20mA output sub-menu and press  $\text{P}$  to reveal the existing rate or total display with one digit flashing. The required display can be entered using the  $\nabla$  or  $\blacktriangle$  push button to adjust the flashing digit and the  $\text{P}$  button to transfer control to the next digit. When set as required press  $\text{E}$  to enter the value and return to the 20.000 prompt in the 4/20mA output sub-menu.

**Note :** If the BA567E-SS Counter and the 4/20mA current sink output are powered from separate supplies, the 4/20mA output current will continue to flow when the BA567E-SS Counter supply fails or is turned off. Powering both from a common supply eliminates this effect.

### 8.6 Display backlight

The BA567E-SS Counter can be supplied with a factory fitted backlight that produce green illumination enhancing display contrast and enabling it to be read at night or in poor lighting conditions. The backlight is internally powered from the instrument therefore no additional wiring is required, but the BA567E-SS supply current increases as shown below.

	<b>BA567E-SS Maximum current consumption</b>
Without backlight	10.0mA
Addition for backlight	22.5mA
Addition with terminals 3 & 4 linked	6.0mA
	-----
Total current	38.5mA max