DESCRIPTION

The BA564G is a field mounting general purpose, two input Counter which will function with a wide variety of sensors. The instrument can display rate and total of the two inputs and their sum or difference.

This abbreviated instruction sheet is intended to assist with installation, a comprehensive instruction manual describing system design and configuration may be downloaded from the BEKA website or may be requested from the BEKA sales

INSTALLATION

The BA564G Counter has a robust IP66 glass reinforced polyester (GRP) carbon loaded enclosure incorporating an armoured glass window and stainless steel fittings. It is suitable for exterior surface mounting in most industrial environments, or pipe mounting using an accessory kit.

If the enclosure is not bolted to an earthed post or structure, the earth terminal on the cable entry bonding plate, which may be assembled on the inside or outside of the enclosure. should be connected to local earthed metalwork or to the plant's potential equalising conductor.

Terminals A1, A2, A3 and A4 are only fitted when the Counter includes optional alarms. Similarly terminals C1, C2, C3 and C4 are only fitted when the instrument has an optional 4/20mA output. See full manual for details.



Step A

Unscrew the four captive 'A' screws and separate the indicator assembly and the back-box.



Step B

Secure the enclosure back-box to a flat surface with M6 screws through the four 'B' holes. Alternatively use a pipe mounting kit.



Step C Remove the temporary hole plug and install an appropriate IP rated cable gland or conduit fitting. Feed the field wiring through the cable entry.




Step D

Terminate field wiring on the instrument assembly. Replace the assembly on the enclosure back-box and tighten the four 'A' screws.

Fig 1 BA564G installation procedure


Abbreviated Instruction for


BA564G general purpose two input field mounting Counter



Issue 3 16th May 2023

BEKA associates Ltd. Old Charlton Rd. Hitchin, Hertfordshire. SG5 2DA, UK Tel: +44(0)1462 438301 Fax: +44(0)1462 453971 e-mail: sales@beka.co.uk weh: www heka co uk








Fig 2 Dimensions and terminal connections

EMC

For specified immunity all wiring should be in screened twisted pairs with screens earthed at one point.




Fig 3 Typical measurement loop

Scale card

The instrument's units of measurement and tag information are shown above the display on a slide-in scale card. New instruments are fitted with a scale card showing the information specified when the instrument was ordered, if this was not provided a blank scale card will be fitted which can easily be marked on-site. Custom printed scale cards are available from BEKA associates

To remove the scale card carefully pull the tab perpendicularly away from the instrument assembly. See Fig 2 for the location of the scale card tab




Fig 4 Inserting scale card into instrument assembly

To replace the scale card carefully insert it into the slot shown in Fig 2. Force should be applied evenly to both sides of the scale card to prevent it twisting. The card should be inserted until about 2mm of the transparent tab remains protruding.

3. **OPERATION**

The BA564G is controlled and configured via four front panel push buttons. In the display mode i.e. when the instrument is counting the push button functions are:

- **■** + **■** Grand total shows the least significant 8 digits of a 16 digit counter.
- + Grand total shows the most significant 8 digits of a 16 digit counter. If buttons are pressed for longer than 10 seconds the grand total will be reset to zero if the grand total reset function [Lr [Lb] is enabled.

To reset the grand total to zero from the operating mode press the **E** and **A** buttons for ten seconds until [Lr. no is displayed. Using the T or L button change the display to £Lr. YE5 and press **E** which will reset the grand total and restore the original display.

- T + A If the local total reset function [Lr Lot is enabled in the configuration menu, simultaneously pressing the **n** and **b** buttons for more than three seconds allows total R, total b or both totals to be selected by operating the \blacksquare or \blacksquare button. Operating the **E** button will then reset the selected total and clear any stored output pulses.
- P + ▼ Shows each for 2 seconds:


Firmware and version number Function of instrument: 25HEntr Options fitted:

- -R Alarms
- -P Pulse output (always fitted)
- -E 4/20mA output
- ₱ + Provides direct access to the alarm setpoints when the Counter is fitted with optional alarms and the RESP setpoints function has been enabled.
- P + E Access to configuration menu

The BA564G is CE marked to show compliance with the EMC Directive 2014/30/EU. It is also UKCA marked to show compliance with UK Electromagnetic Compatibility Regulations UKSI 2016:1091 (as amended)

4. CONFIGURATION

Counters are supplied configured as requested at time of ordering, if not specified default configuration will be supplied but can easily be changed on-site. Fig 5 shows the location of each function within the configuration menu with a brief summary of the function. Please refer to the full instruction manual for detailed configuration information and for description of optional outputs. Access to the configuration menu is obtained by pressing the P and E buttons simultaneously. If the Counter's security code is set to default DDD the first parameter in Public R will be displayed. If the instrument is protected by a security code. Lode will be displayed. The four digit code must be entered to gain access to the menu.

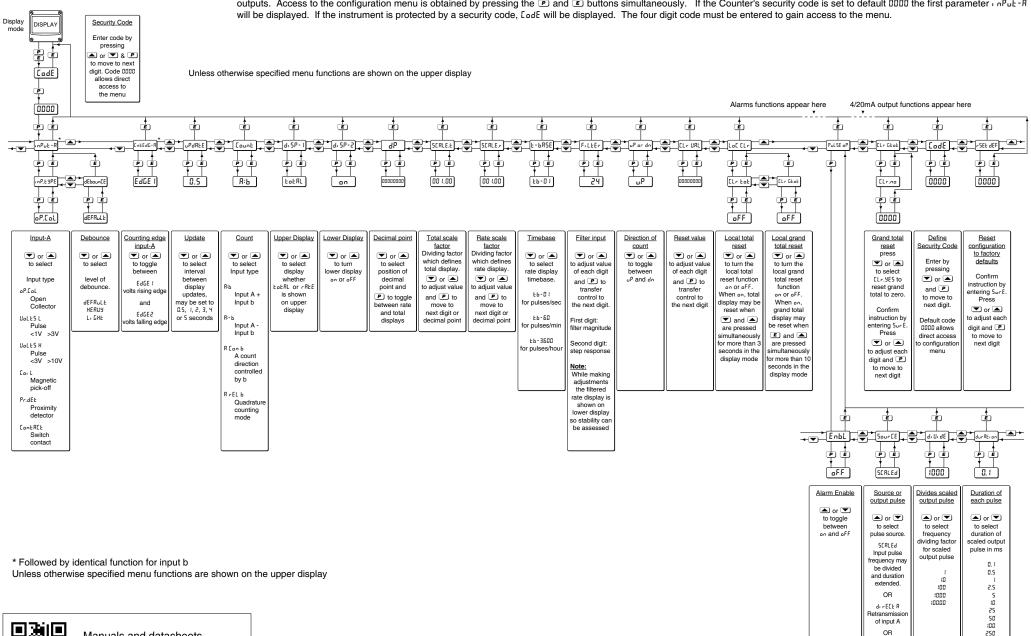



Manuals and datasheets can be downloaded from http://www.beka.co.uk/ba564g

dirEEE b

Retransmissio

of input b

These functions only appear in

sub-menu when SERLEd is