


# QUALITY ASSURANCE NOTIFICATION

## Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

1. **Manufacturers Notification Number:** ITS09ATEXQ6173 Issue 7
2. **Explosion Protection concept(s) covered by this Notification:** See Schedule 1
3. **Manufacturer:** BEKA associates Ltd.
4. **Address:** Old Charlton Road  
Hitchin,  
Herts. SG5 2DA  
United Kingdom
5. Intertek Testing and Certification Limited, Notified Body No. 0359 for Annexes IV and VII in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, confirms that the manufacturer has a quality system which complies with Annex IV of the Directive.
6. Full details of the Audit are held in Intertek Report 103939456LHD-001 Issue: 0 Dated: 27<sup>th</sup> September 2019.
7. This Notification may be withdrawn if the manufacturer no longer satisfies the requirements of Annex IV. Periodic inspection forms part of this Notification.
8. This Notification is valid until 3<sup>rd</sup> October 2022 and can be withdrawn if the manufacturer does not satisfy the quality assurance re-assessment.
9. The CE marking shall be followed by the identification number 0359 identifying the Notified Body involved in the production control stage required by Article 16 of the Directive 2014/34/EU.
10. This Notification may only be reproduced in its entirety and without any change, Schedule included.

**Certification Officer:**  **Date:** 30<sup>th</sup> September 2019  
V K Varma

## **SCHEDULE 1:**

**MANUFACTURERS NOTIFICATION NUMBER: ITS09ATEXQ6173 Issue 7**

### **Explosion Protection Concepts for which the Manufacturer has been assessed:**

Intrinsic Safety “ia”, “ib”  
Flameproof “d”  
Increased Safety “e”  
Pressurised enclosures “p”  
Dust Protection “t”


### **Equipment Types for which the Manufacturer has been assessed:**

Communication and telemetry equipment (alarm sounders and loudspeakers) Instrumentation, measurement and control equipment.

Luminaires, lamps & accessories

Signalling & detection products in types of protection:

Flameproof enclosure “d”, increased safety “e”, pressurized enclosure “p” and dust ignition protection by enclosure “t”

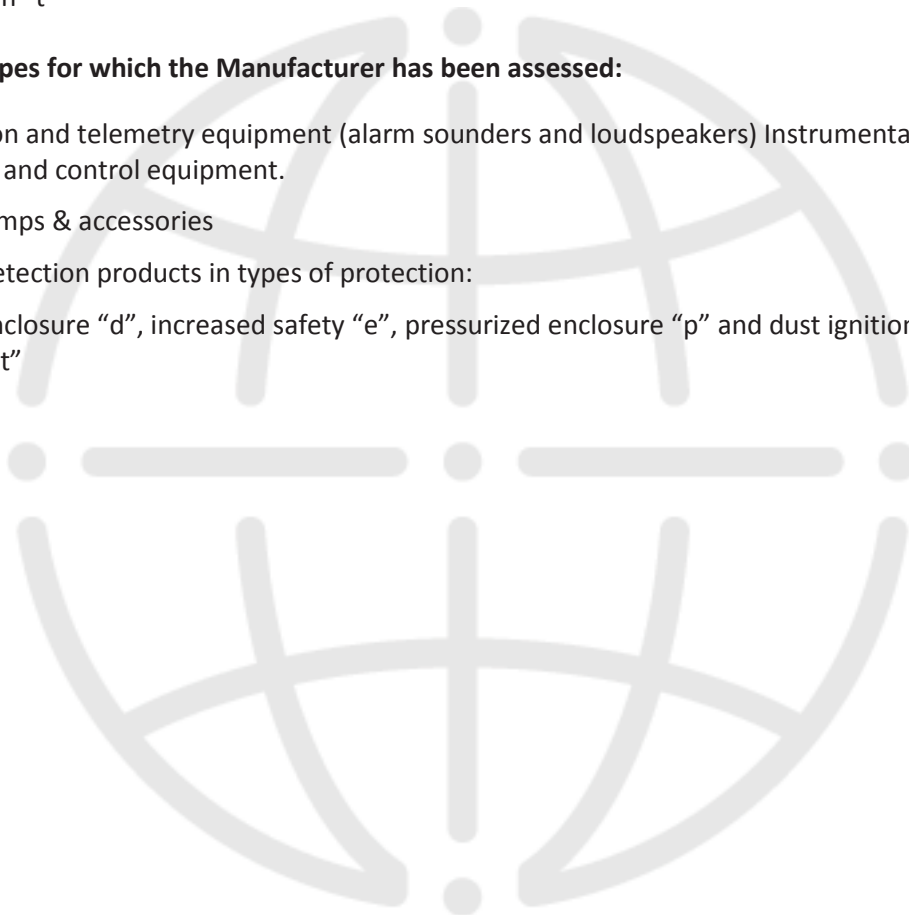

**Issue 7:** Reassessment audit carried out with satisfactory results on 3<sup>rd</sup> September 2019